


SCREEN CREATOR 5
User's Manual



Vol. 4
STANDARD PARTS
CATALOG



■ Contents

CHAPTER 1 USING STANDARD PARTS

1-1. Classification of Parts.....	1-1
1-2. Names of Parts	1-3
1-3. Files and Management of Parts	1-4
1-4. Operation Parameters of Parts	1-5
1-5. Changing Parts	1-6
1-6. Memories of Parts.....	1-7

CHAPTER 2 NUMERAL DISPLAYS

2-1. Numeral display	2-1
2-2. Input numeral display (Word)	2-3
2-3. Input numeral display (double words).....	2-4
2-4. Dedicated to byte device.....	2-5
2-4-1. Numeral display (4 bytes)	2-5
2-4-2. Input numeral display (2 bytes)	2-6
2-4-3. Input numeral display (4 bytes)	2-7

CHAPTER 3 CHARACTER DISPLAYS

3-1. Registered text display	3-1
3-2. ASCII text display.....	3-2
3-3. Input text display	3-3
3-4. Registered text display with scroll	3-4
3-5. Bar-code display	3-5
3-6. Input bar-code display	3-6
3-7. Dedicated to byte device.....	3-7
3-7-1. ASCII text display (byte)	3-7
3-7-2. Input text display (byte)	3-8
3-7-3. Input bar-doce display (byte).....	3-9

CHAPTER 4 LAMPS

4-1. LED.....	4-1
4-2. Mark lamp	4-2
4-3. Name plate lamp	4-3
4-4. Name plate setup lamp	4-4
4-5. Piping lamp	4-5
4-6. For each bit of a word device	4-7
4-6-1. LED(for word).....	4-7
4-6-2. Mark lamp(for word)	4-8
4-6-3. Name plate lamp(for word).....	4-9

CHAPTER 5 SWITCHES

5-1. Mark switch..... 5-1
 5-2. Mark switch with monitor..... 5-3
 5-3. Name plate switch 5-5
 5-4. Name plate switch with monitor 5-7
 5-5. Toggle/selector 5-9

CHAPTER 6 TEN-KEY PADS / KEYBOARDS

6-1. Ten-key pad(for input numeral display)..... 6-1
 6-2. Keyboard(for input text display) 6-2
 6-3. Ten-key pad/volume(direct write)..... 6-4

CHAPTER 7 SCREEN SELECT PARTS

7-1. Screen select switch 7-1
 7-2. Screen select switch (notice type) 7-2
 7-3. Screen select control part 7-3

CHAPTER 8 METERS

8-1. Analog meter 8-1
 8-2. Bar meter 8-2
 8-3. Slide meter 8-3
 8-4. Free meter 8-4

CHAPTER 9 GRAPHS

9-1. Trend graph 9-1
 9-2. Trend graph (data storing type) 9-2
 9-3. Bar/line graph 9-4
 9-4. Zone/circle graph 9-5
 9-5. Pareto chart 9-6

CHAPTER 10 CLOCKS / CALENDARS

10-1. Clock..... 10-1
 10-2. Calendar 10-2
 10-3. Clock/calendar setup 10-3

CHAPTER 11 ALARMS

11-1. Error display (ERRPTS)..... 11-1
 11-2. Warning display (bit devices) 11-2
 11-3. Warning display (word devices) 11-5

CHAPTER 12 TEXTURE DISPLAYS

12-1. Registered texture display 12-1

CHAPTER 13 SPECIAL PARTS

13-1. Screen print.....	13-1
13-2. Parts control.....	13-2
13-3. Brightness adjustment.....	13-3
13-4. Back-light control.....	13-4
13-5. Interlock control.....	13-5
13-6. Heat regulator	13-6
13-7. Non-protocol communication.....	13-7

CHAPTER 14 HOST COMMAND COMMUNICATION PARTS

14-1. Numeral display (host commands).....	14-1
14-2. Character display (host commands).....	14-2
14-3. Lamp (host commands)	14-3
14-3-1. LED (host commands)	14-3
14-3-2. Mark lamp(host commands)	14-4
14-3-3. Name plate lamp(host commands)	14-4
14-4. Switch (host commands).....	14-5
14-4-1. Mark switch (host commands)	14-5
14-4.2. Name plate switch (host commands)	14-5

SUPPLEMENT ISO7000 TEXTURE

0001 - 0100	SUPPLEMENT-1
0101 - 0200	SUPPLEMENT-2
0201 - 0300	SUPPLEMENT-3
0301 - 0400	SUPPLEMENT-4
0401 - 0500	SUPPLEMENT-5
0501 - 0600	SUPPLEMENT-6
0601 - 0700	SUPPLEMENT-7
0701 - 0800	SUPPLEMENT-8
0801 - 0900	SUPPLEMENT-9
0901 - 1000	SUPPLEMENT-10
1001 - 1100	SUPPLEMENT-11
1101 - 1140	SUPPLEMENT-12

A guide to use this manual

This Screen Creator 5 facilitates you to create screens by arranging parts such as lamps, switches, numeral displays, etc.

The Screen Creator 5 prepares a variety of standard parts. This manual describes those parts.

It is recommended to refer to the following manuals, as well when using this equipment.

Vol. 1 Screen Creator 5 Manual (Introduction)

This manual describes the basic operation methods of the Screen Creator 5.

Vol. 2 Screen Creator 5 Manual (Operation)

This manual describes details of each operation of the Screen Creator 5.

Vol. 3 Screen Creator 5 Manual (Connection to a PLC/External Devices)

This manual describes how to communicate with an PLC and a host computer and how to connect this equipment to external devices.

Vol. 4 Screen Creator 5 Manual (Standard Parts Catalog)

This manual explains functions of the standard parts supplied by Koyo.

Vol. 5 Screen Creator 5 Manual (Control Reference)

This is a reference manual for controls used for creating parts.

Vol. 6 Screen Creator 5 Manual (K-Basic Program Description)

This manual explains how to describe operation programs for creating screens, as well as necessary commands for the purpose.

Vol. 7 Screen Creator 5 Manual (Troubleshooting and List of Error Codes)

This manual describes restrictions for creating screens on the Screen Creator 5, how to process troubles, and explains error codes.

Safety Precautions

Be sure to follow the safety precautions listed below in order to use this equipment safely. Koyo cannot be held liable for any damages incurred if these safety precautions are not followed.



WARNING

- **Design your system so that there are sufficient countermeasures for personnel accidents and major equipment accidents. The system should have an external protection and safety circuit, so that even if the OIP should malfunction or even if there is a defect in the program the safety of the system is assured.**
- **Do not use the touch panel of the OIP to make switches that are related to safety or people or major damages (emergency safety switches, etc.). Be sure that the system is designed so that it can cope with any errors or malfunctions in the touch panel.**
- **Be sure that type 3 grounding is used for the protective-grounding terminal. There is a possibility of electrical shock if the unit is not grounded.**
- **If the OIP should malfunction, immediately turn off the power and leave it alone.**
- **If there is direct output to external output device such as PLCs, direct output will be driven regardless of the ladder circuit interlock. Output may be used to drive motors and the like, so avoid using direct output because it is dangerous.**



CAUTION

- **Use and store the OIP in the environment described in the specifications (regarding vibration, shock, temperature, humidity, etc.).**
- **Do not use the OIP where it is subjected to inflammable or explosive gas, or steam.**
- **Before turning on the power, be sure that the power voltage rating of the OIP and the voltage rating power supply match. Using a mistaken power supply can damage the unit.**
- **Do not disassemble or modify the OIP. Doing so can cause malfunctions and lead to other problems.**
- **The OIP touch panel is made of glass. Striking it with hard objects or pressing hard on it may break the glass.**
- **Do not push down on the OIP touch panel with mechanical pencils, screwdrivers, or other sharp objects. Doing so can damage the touch panel or cause malfunctions.**

Notations Used In This Manual

This manual uses the following symbol marks for you to use this system comfortably.



WARNING

Describes a peril that may cause operator's death or serious injury in neglecting the WARNING item(s).



Caution

Describes a peril that may cause bodily injury or serious device damage in neglecting the CAUTION items(s).



Describes general note(s) in use.

Note)

Explanations and supplements.

Glossaries used in this manual are as follows.

OIP

Stands for Operator Interfase Panel.

PLC

Stands for programmable controller. It is also called a sequence controller.

Link unit

A link unit is a communication equipment which connects this equipment and the PLC. The nomenclature of the communication equipment is different from each manufacture and the equipment is called a link unit in general.

Device

A device is such equipment that an input/output relay, internal relay, timer, counter, or resister in the PLC.

Notice

We have used our best efforts in preparing this manual. We make no warranties with respect to the accuracy, or completeness of the contents of this manual and purpose. We shall not be liable any loss of profit or any other commercial damages, applying this manual directly and indirectly.

- 1) All rights reserved. No part of this book may be reproduced in any form or by any means, without permission in writing from Koyo Electronics Industries Co.,Ltd..
- 2) Contents of this manual shall be subject to change without notice.
- 3) While every precaution has been taken in the preparation of this manual, if the reader notice any errors or has any advice on the contents of this manual, please contact our customer support in Sales Division of Koyo Electronics Industries Co.,Ltd..
- 4) We shall have no liability to any loss or damage caused or alleged to be caused directly or indirectly by the statements contained in this manual or by the computer software and hardware products described in it.
- 5) Koyo Electronics Industries Co.,Ltd.. may have patents or pending patent applications, copyrights, or other intellectual property rights covering subject matter in this manual. The furnishing of this manual does not give you any license to these patents or other intellectual property rights. And we do not have any responsibility on troubles involved in the patents and other intellectual rights caused by the use of this manual.
- 6) Contact us at the following place concerning other unclear points in this manual.

**Overseas Division
Koyo Electronics Industries Co.,Ltd.**

Address: 1-171 Tenjin-cho, Kodaira, Tokyo 187-0004 Japan
Telephone: 81-42-341-7711
Facsimile: 81-42-342-6871
Mail: OSD@koyoele.co.jp

Version Up

Koyo Electronics Industries Co.,Ltd. Ltd. has upgraded Screen Creator 5 for adding new functions, operationability and so forth.

Below will be introduced the updated functions.

1. Version 2.10

- Supporting middle size systems (GC53) of GC5X Series
- Adding the uploading editing function

To make this function effective, attach all screen data and K-Basic programs used in the project and download them to the panel. Then download the uploaded entities from the panel and restore them. Then you can edit the data and programs. Note that the data with the project attached increase their size.

- The following PLCs have been added.









Koyo	Koyo KOSTAC SA/SR
Omron	SYSMAC α
Fuji Dencki	FLEX-PC NJ-T/NS-T
Fuji Dencki	Computer-link protocol
Fuji Dencki	Loader command protocol
Toyota Koki	PC1
Toyota Koki	PC3
Matsushita Electric Industry	Panadac 7000

- Standard components, centered on the parts used for middle size systems (GC53) in the GC5X Series have drastically been added.

1. USING STANDARD PARTS






The Screen Creator 5 prepares a variety of standard parts including lamps, switches, etc. Please read this manual thoroughly before using any of those standard parts.

1-1. Classification of Parts

Icon	Category	Detailed Category	Page
	Numeral displays	Numeral display	2-1
		Input numeral display (word)	2-3
		Input numeral display (double words)	2-4
		Dedicated to byte devices	2-5
	Character displays	Registered text display	3-1
		ASCII text display	3-2
		Input text display	3-3
		Registered text display with scroll	3-4
		Bar-code display	3-5
		Input bar-code display	3-6
	Lamps	LED	4-1
		Mark lamp	4-2
		Name plate lamp	4-3
		Name plate setup lamp	4-4
		Piping lamp	4-5
		For each bit of a word device	4-6
	Switches	Mark switch	5-1
		Mark switch with monitor	5-3
		Name plate switch	5-5
		Name plate switch with monitor	5-7
	Ten-key pads/ keyboards	Ten-key pad (for input numeral display)	6-1
		Keyboard (for input text display)	6-2
		Ten-key pad/volume (direct write)	6-4
	Screen select parts	Screen select switch	7-1
		Screen select switch (notice type)	7-2
		Screen select control part	7-3
	Meters	Analog mete	8-1
		Bar meter	8-2
		Slide meter	8-3
		Free meter	8-4
	Graphs	Trend graph	9-1
		Trend graph(data storing type)	9-2
		Bar/line graph	9-4
		Zone/circle graph	9-5


		Pareto chart	9-6
--	--	--------------	-----

1. Using Standard Parts

Icon	Category	Detailed Category	Page
	Clocks/calendars	Clock	10-1
		Calendar	10-1
		Clock/calendar setup	10-2
	Alarms	Error display (ERRPTS)	11-1
		Warning display (bit devices)	11-2
		Warning display (word devices)	11-5
	Texture displays		12-1
	Special parts	Screen print	13-1
		Parts control	13-2
		Brightness adjustment	13-3
		Back-light control	13-4
		Interlock control	13-5
		Heat regulator	13-6
		Non-protocol communication	13-7
	Host command communication parts	Numeral display (host commands)	14-1
		Character display (host commands)	14-2
		Lamp (host commands)	14-3
		Switch (host commands)	14-5

Before searching any part of the Screen Creator 5 in this manual, make the "Screen Creator 5" parts selection menu match with the parts categories in this manual.

Example) "Screen Creator 5" parts selection menu

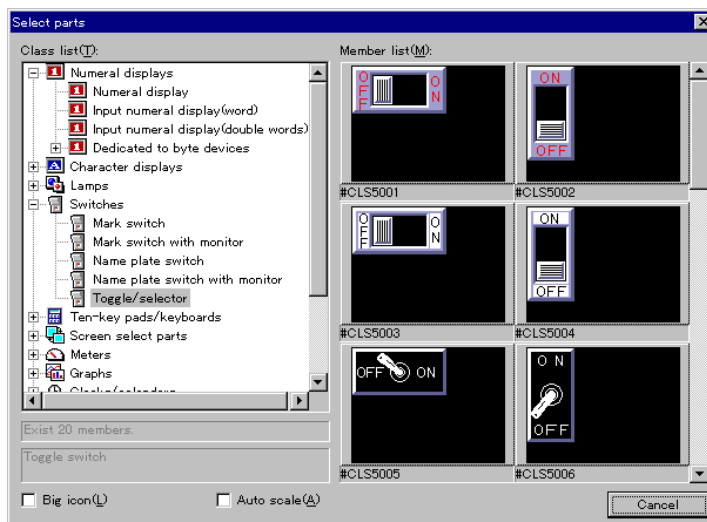


Example) A parts category in this manual

Switches Toggle/selector	Toggle Switch	D: About 690 bytes S: About 260 bytes
-----------------------------	---------------	--

1. Using Standard Parts

1-2. Names of Parts

The standard parts of the "Screen Creator 5" are named on the following rules.

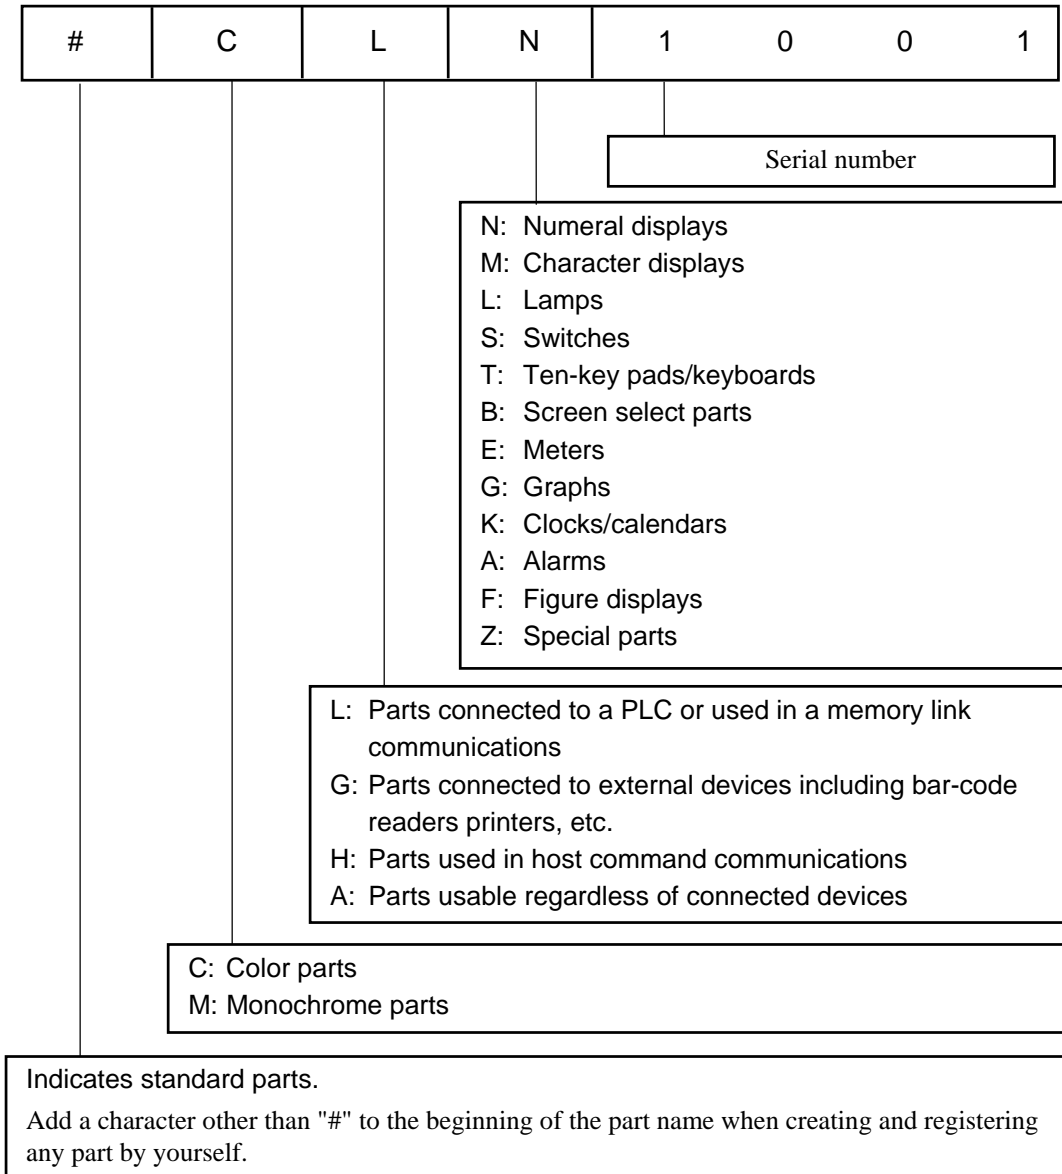

1. Using Standard Parts

1-3. Files and Management of Parts

The standard parts of the "Screen Creator 5" are stored in the following file.
The file name is "PART NAME.APT".

[For color parts] "%LIB%\APT" in the folder in which the "Screen Creator 5" is installed.
--

[For monochrome parts] "%LIB%\APTM" in the folder in which the "Screen Creator 5" is installed.
--

A parts management file has been added in and after "Screen Creator 5".

The file stores information indicating the parts groups to which user-created parts are belonging.
This management information is stored in the following file.

[For color parts] "%LIB%\BCLIB.PLB" in the folder in which the "Screen Creator 5" is installed.
--

[For monochrome parts] "%LIB%\BMLIB.PLB" in the folder in which the "Screen Creator 5" is installed.


[Note]

Do not change the file name nor edit the contents in the file unnecessarily.

1. Using Standard Parts

1-4. Operation Parameters of Parts

- Operation parameters must be set for almost all parts when those parts are arranged on a screen. Read this manual carefully to specify those parameters.

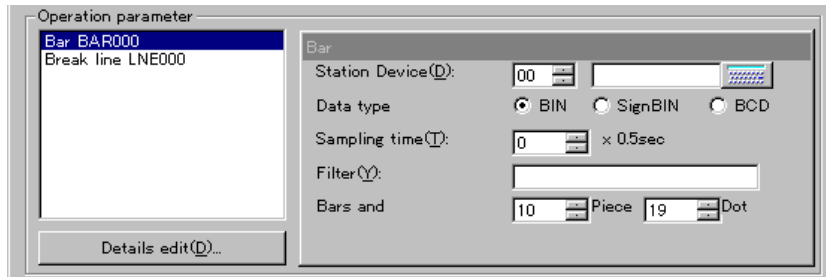

[Note]

As shown above, one part may have two or more operation parameter windows ("bar graph" and "break line graph") in some cases. Be careful not to forget entry of necessary parameters.

- Operation parameters are classified into "control" parameters and "program (K-Basic)" parameters. A "program" parameter is referred to as a "template" and the portion enclosed by [] in a program is assumed as the "template".

[Note]

If nothing is described in a "template", it is regarded that the program includes no "template" line.

- A "filter" may exist as a control parameter. This parameter is specified to display a corrected value of the connected device. Assume the value of a connected device as "X" to describe each expression using "+, -, *, /, and ()".

Example) "filter": (X+50)/2

- The mark placed at the start of each "operation parameter" in this manual has the following meaning.

◎	Indicates that the parameter is mandatory, although it has no initial value. If not specified, an error occurs when in data creation.
○	Indicates that the parameter value should be changed as needed. (The default value may also be used as is, of course.)
△	Indicates that the parameter is omissible. The object part can work normally even when the parameter is omitted.


Example) "Bar graph" operation parameters

Parameter	Initial Value	Description
[Bar graph setup]		
○ [station No.]	01	Enter the PLC station number.
◎ [device name]		Enter the name of the first device for which a graph is displayed.
○ [data type]	BIN	Enter the data type according to the connected device type.
○ [sampling time]	0	Fixed to "0".
△ [filter]		Set this parameter when displaying a corrected value of the connected device.

1. Using Standard Parts

1-5. Changing Parts

- The texture and color of each part can be changed easily by specifying "background texture" and "background color" in "Property of arrangement parts".

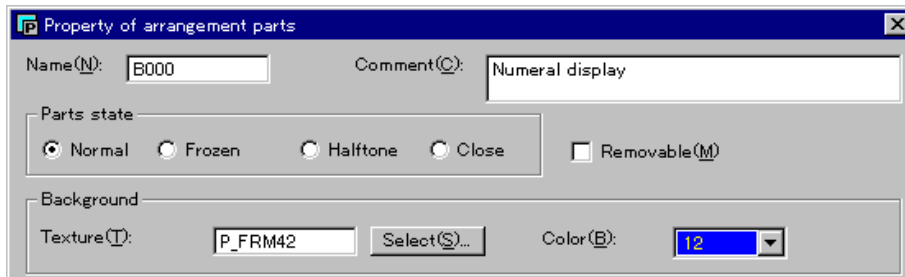


[Note]


Read this manual carefully when changing lamp parts and switch parts.

- A simple control change of any part can be made with "Details edit" of "Operation Parameters". As such an example, the type of a switch part is changed from "momentary" to "alternate" here.

- Example)
1. Select "mark switch" from "Switches" of the parts categories and arrange the mark switch on the screen.
 2. Click "Details edit" of the switches from the "Property of arrangement parts".

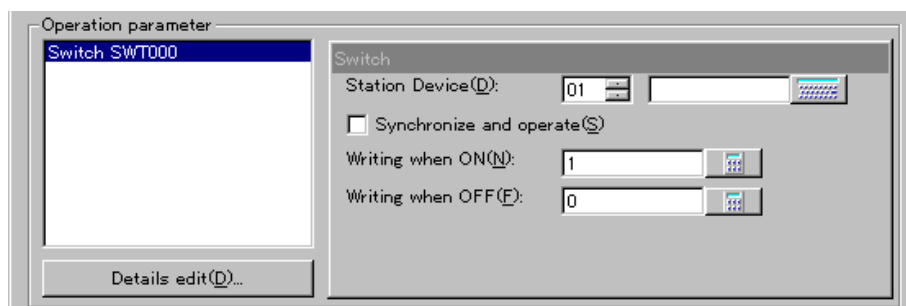

3. Change the "TYPE" in the switch setup window to "Alternate".

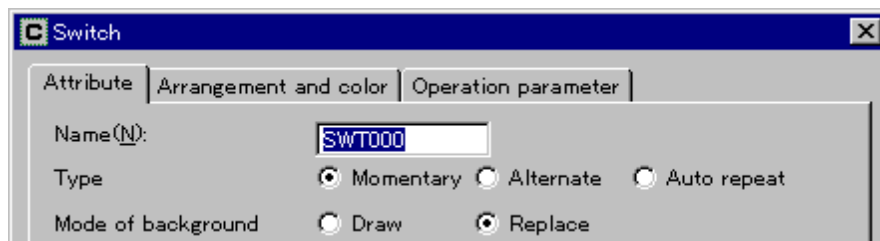

4. Click "OK" in the switch setup window.

[Note]

Control setting cannot be changed for parts whose control is displayed with K-Basic.

1-6. Memories of Parts

- This manual describes how much memory is used for each part. The panel of this equipment has "data memory" and "system memory". This manual describes each memory used for each part arranged on a screen.

"D: About ??? bytes": Data memory space used per part.

"S: About ??? bytes": System memory space used per part.

Example) Memories used by an "LED" of "lamps".

Lamps	LED	D: About 160 bytes
LED		S: About 110 bytes

Data memory: Used by about 160 bytes.

System memory: Used by about 110 bytes.

[Notes]

- The memory consumption per part should be taken only as standard for reference.
- The memory consumption per part is calculated according to the initial value of the part in its "operation parameters".
- The memory consumption changes a little according to the PLC type and connected device.

2. NUMERAL DISPLAYS



Numeral displays		Numeral display			D: About 160 bytes
Numeral display					S: About 130 bytes
#CLN1001	#CLN1002	#CLN1003	#CLN1004	#CLN1005	
#MLN1001	#MLN1002	#MLN1003	#MLN1004	#MLN1005	
#CLN1006	#CLN1007	#CLN1008	#CLN1009	#CLN1010	
#MLN1006	#MLN1007	#MLN1008	#MLN1009	#MLN1010	
#CLN1011	#CLN1012	#CLN1013	#CLN1014	#CLN1015	
#MLN1011	#MLN1012	#MLN1013	#MLN1014	#MLN1015	
#CLN1016	#CLN1017	#CLN1018			
#MLN1016	#MLN1017	#MLN1018			

■ Function

- This part displays the value of its connected device.

■ Operation parameters

Parameter	Initial Value	Description
[Number indicator setting]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device whose value is to be displayed. For a double-word device, enter the name of the first device.
<input type="radio"/> [device type]	word	Enter the number of words to display.
<input type="radio"/> [endian]	little	Valid when double words are specified. Little: The lower word comes first. Big: The upper word comes first.
<input type="radio"/> [data type]	sign BIN	Enter the type of the connected device.
<input type="checkbox"/> [filter]		Specify this parameter when displaying a corrected value of the connected device.
<input type="radio"/> [color]	1 or 11	Set the numeral color.

■ Remark

- The "endian" specification will be as shown below when "double words" is specified.
Example) When "R2000" is specified for "device name"
"little": "R2000" value "1", "R2001" value "0" → Numeral display "1"
"big": "R2000" value "1", "R2001" value "0" → numeral display "65536"
- The decimal point can be put at any digit when "position of point" is specified for "Details edit" of the numeral displays. (This is valid only when "Fixed 2" is specified for "decimal point".)
Example) When [position of point] = 2: Connected device value "1234" → display value "12.34"

2. Numeral Displays

1

Numeral displays	Numeral display	D: About 160 bytes
Numeral display		S: About 130 bytes

#CLN1051	#CLN1052	#CLN1053	#CLN1054	#CLN1055
#MLN1051	#MLN1052	#MLN1053	#MLN1054	#MLN1055
1	1	12	12	123
#CLN1056	#CLN1057	#CLN1058	#CLN1059	#CLN1060
#MLN1056	#MLN1057	#MLN1058	#MLN1059	#MLN1060
123	1234	1234	12345	12345

■ Function

- This numeral display displays the value of a connected device.

■ Operation parameters

Parameter	Initial Value	Description
[Number indicator setting]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device whose value is to be displayed. For a double-word device, enter the name of the first device.
<input type="radio"/> [device type]	word	Specify the number of words to display.
<input type="radio"/> [endian]	little	This parameter is valid when double words are specified. Little: The lower word comes first. Big: The upper word comes first.
<input type="radio"/> [data type]	signed BIN	Specify the type of the connected device.
<input type="checkbox"/> [filter]		Specify this parameter to display a corrected value of the connected device.
<input type="radio"/> [color]	1 or 11	Specify the color used for numerals.

■ Remark

- The specifications of [endian] will be as shown below when [double words] is specified.
Example) When "R2000" is specified for [device name]
"Little": "R2000" value... "1", "R2001" value... "0" → displayed numeral... "1".
"Big": "R2000" value... "1", "R2001" value... "0" → displayed numeral... "65536".
- If "position of point" is specified for "EDIT DETAILS" of numeral displays, the decimal point can be displayed at a given digit. (This is valid when "fixed 2" is specified for "decimal point".)
Example) When [position of point]=2: Connected device value "1234" → displayed value "12.34".

2. Numeral Displays



Numeral display Input numeral display (word)	Input numeral display (Word)	D: About 1700 bytes S: About 210 bytes
---	---------------------------------	---

#CLN2001	#CLN2002	#CLN2003	#CLN2004	#CLN2005
#MLN2001	#MLN2002	#MLN2003	#MLN2004	#MLN2005
123456	123456	123456	123456	123456
#CLN2006	#CLN2007	#CLN2008	#CLN2009	#CLN2010
#MLN2006	#MLN2007	#MLN2008	#MLN2009	#MLN2010
123456	123456	123456	123456	12345
#CLN2011		#CLN2051	#CLN2052	#CLN2053
#MLN2011		#MLN2051	#MLN2052	#MLN2053
12345		1	1	12
#CLN2054	#CLN2055	#CLN2056	#CLN2057	#CLN2058
#MLN2054	#MLN2055	#MLN2056	#MLN2057	#MLN2058
12	123	123	1234	1234

■ Function

- This part is combined with a "ten-key pad (input)" for use.
- Pressing this part opens the ten-key pad. The data entered from the ten-key pad is written in a PLC and displayed as a value.
- The upper and lower limits of the value entered from the ten-key pad are checked. If the value is not within the preset limits, the value is not written in the PLC and retry of the value entry is requested.
- Specify [next part name]. The cursor goes to the next "input numeral display" part. This function is useful for setting values continuously.
- The decimal point can be set at any digit when [position of point] is specified.
Example) When [position of point] = 2: Connected device value "1234" → display value "12.34"

■ Operation parameters

Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [connected device name]		Enter the name of the device to which a value is to be written and displayed.
<input type="radio"/> [position of point]	0	Specify the position where the decimal point is to be displayed.
<input type="radio"/> [BIN:1, ±BIN:2/BCD:3]	2	Select the type of the connected device.
<input type="checkbox"/> [next part name]		Enter the name of the part to which the cursor is to be moved. If no next part exists, enter nothing.
<input type="radio"/> [input min. value]	0	Enter the lower limit value of input data.
<input type="radio"/> [input max. value]	9 - 10000	Enter the upper limit value of input data.
<input type="checkbox"/> [screen name having ten-key pad]		Enter the name of the global screen when the ten-key pad is on a global screen. Enter nothing if the ten-key pad is on the self-screen.
<input checked="" type="radio"/> [ten-key pad name]		Enter the name of the ten-key pad.
<input type="checkbox"/> [self-screen:1/global screen: none]	1	Enter "1" when the ten-key pad is on the self-screen. Enter nothing when the ten-key pad is on a global screen.

Numeral displays Input numeral display (double words)		Input numeral display (double words)			D: About 2110 bytes S: About 240 bytes
#CLN3001	#CLN3002	#CLN3003	#CLN3004	#CLN3005	
#MLN3001	#MLN3002	#MLN3003	#MLN3004	#MLN3005	
#CLN3006	#CLN3007	#CLN3008	#CLN3009		
#MLN3006	#MLN3007	#MLN3008	#MLN3009		
		12345678	12345678		

■ Function

- This part is combined with a "ten-key pad (input numerals)" for use.
- Pressing this part opens the ten-key pad. The data entered from the ten-key pad is written in a PLC and displayed as a value.
- The upper and lower limits of the value entered from the ten-key pad are checked. If the value is not within the limits, the value is not written in the PLC and retry of the value entry is requested.
- Specify [next part name]. The cursor goes to the next "input display" part. This function is useful for setting values continuously.
- The decimal point can be set at any digit when [position of point] is specified.
Example) When [position of point] = 2: Connected device value "1234" → display value "12.34"

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [connected device name]		Enter the name of the device to which a value is to be written and displayed.
<input type="radio"/> [position of point]	0	Specify the position where the decimal point is to be displayed.
<input type="radio"/> [data listing lower:1/upper:2]	1	Specify the first word of the double words.
<input type="radio"/> [BIN:1, ±BIN:2/BCD:3]	2	Select the type of the connected device.
<input type="checkbox"/> [next part name]		Enter the name of the part to which the cursor is to be moved. If no next part exists, enter nothing.
<input type="radio"/> [input min. value]	0	Enter the lower limit value of input data.
<input type="radio"/> [input max. value]	1000000	Enter the upper limit value of input data.
<input type="checkbox"/> [screen name having ten-key pad]		Enter the name of the global screen when the ten-key part is on a global screen. Enter nothing if the ten-key pad is on the self-screen.
<input checked="" type="radio"/> [ten-key pad name]		Enter the name of the ten-key pad.
<input type="checkbox"/> [self-screen:1/global screen:none]	1	Enter "1" when the ten-key pad is on the self-screen. Enter nothing when the ten-key pad is on a global screen.

■ Remark

- The [data listing lower/upper] specification is as shown below.
Example) When "R2000" is specified for [connected device name]
Lower: Entered value "123" → "R2000" value "123", "R2001" value "0"
Upper: Entered value "123" → "R2000" value "0", "R2001" value "123"

2. Numeral Displays



Numeral displays Numeral display (4 bytes) dedicated to byte devices	Numeral display (4 bytes)	D: About 740 bytes S: About 170 bytes
--	------------------------------	--

#CLN4101	#CLN4102	#CLN4103	#CLN4104	#CLN4105
#MLN4101	#MLN4102	#MLN4103	#MLN4104	#MLN4105
12345678	12345678	12345678	12345678	12345678
#CLN4106	#CLN4107	#CLN4108		
#MLN4106	#MLN4107	#MLN4108		
12345678	12345678	12345678		

■ Function

- This part is used only for a PLC having byte devices.
- This part displays values of the connected devices for 4 bytes (equal to double words).
- When displaying the values of the connected devices for 2 bytes (equal to a word), an ordinary "numeral display" part (#CLN1001/#MLN1001, etc.) can be used. At this time, [device type] of the part must be specified for "double words". (For a byte device, this function displays the data for a word.
- The decimal point can be displayed at any digit when [position of point] is specified.
Example) When [position of point] = 2, connected device value "1234" → display value "12.34"

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [connected device name]		Enter the name of the first device to which a value is to be displayed.
<input type="radio"/> [position of point]	0	Specify the position where the decimal point is to be displayed.
<input type="radio"/> [data listing lower:1/upper:2]	1	Specify the data of the first device of the four connected byte devices.
<input type="radio"/> [±BIN:2/BCD:3]	2	Select the type of each connected device.

■ Remark

- The [data listing lower/upper] specification is as shown below.
Example) When "E100" is specified for "device name"
Lower: "E100" value "1", "E101" to "E103" values "0" → display value "1"
Upper: "E100" value "1", "E101" to "E103" values "0" → display value "16777216"

Numeral displays Input numeral display (2 bytes) dedicated to byte devices	Input numeral display (2 bytes)	D: About 2300 bytes S: About 250 bytes
--	------------------------------------	---

#CLN4201	#CLN4202	#CLN4203	#CLN4204	#CLN4205
#MLN4201	#MLN4202	#MLN4203	#MLN4204	#MLN4205
123456	123456	123456	123456	123456
#CLN4206	#CLN4207	#CLN4208	#CLN4209	
#MLN4206	#MLN4207	#MLN4208	#MLN4209	
123456	123456	123456	123456	
#CLN4251	#CLN4252	#CLN4253	#CLN4254	
#MLN4251	#MLN4252	#MLN4253	#MLN4254	
123	123	1234	1234	

■ Function

- This part is used only for a PLC having byte devices.
- This part receives and displays a value of a 2-byte (equal to a word) connected device.
- This part is combined with a "ten-key pad (input numerals)" for use.
- Pressing this part opens the ten-key pad. The data entered from the ten-key pad is written in a PLC and displayed as a value.
- The upper and lower limits of the value entered from the ten-key pad are checked. If the value is not within the limits, the value is not written in the PLC and retry of the value entry is requested.
- Specify [next part name]. The cursor goes to the next "input numeral display" part. This function is useful for setting values continuously.
- The decimal point can be set at any digit when [position of point] is specified.
Example) When [position of point] = 2: Connected device value "1234" → display value "12.34"

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [connected device name]		Enter the name of the device to which a value is to be written and displayed.
<input type="radio"/> [position of point]	0	Specify the position where the decimal point is to be displayed.
<input type="radio"/> [data listing lower:1/upper:2]	1	Specify the data of the first device of the two connected byte devices.
<input type="radio"/> [BIN:1, ±BIN:2/BCD:3]	2	Select the type of the connected device.
<input type="checkbox"/> [next part name]		Enter the name of the part to which the cursor is to be moved. If no next part exists, enter nothing.
<input type="radio"/> [input min. value]	0	Enter the lower limit value of input data.
<input type="radio"/> [input max. value]	999 - 10000	Enter the upper limit value of input data.
<input type="checkbox"/> [screen name having ten-key pad]		Enter the name of the global screen when the ten-key pad is on a global screen. Enter nothing if the ten-key pad is on the self-screen.
<input checked="" type="radio"/> [ten-key pad name]		Enter the name of the ten-key pad.
<input type="checkbox"/> [self-screen:1/global screen:none]	1	Enter "1" when the ten-key pad is on the self-screen. Enter nothing when the ten-key pad is on a global screen.

■ Remark

- The [data listing lower/upper] specification is as shown below.
Example) When "E100" is specified for [connected device name]
Lower: Input value "123" → "E100" value "123", "E101" "0"
Upper: Input value "123" → "E100" value "0", "E101" value "123"

2. Numeral Displays



Numeral displays Input numeral display (4 bytes) dedicated to byte devices	Input numeral display (4 bytes)	D: About 2800 bytes S: About 300 bytes
--	--	---

#CLN4301	#CLN4302	#CLN4303	#CLN4304	#CLN4305
#MLN4301	#MLN4302	#MLN4303	#MLN4304	#MLN4305
12345678	12345678	12345678	12345678	12345678
#CLN4306	#CLN4307	#CLN4308	#CLN4309	
#MLN4306	#MLN4307	#MLN4308	#MLN4309	
12345678	12345678	12345678	12345678	

■ Function

- This part is used only for a PLC having byte devices.
- This part receives and displays a value of a 4-byte (equal to double words) connected device.
- This part is combined with a "ten-key pad (input numerals)" for use.
- Pressing this part opens the ten-key pad. The data entered from the ten-key pad is written in a PLC and displayed as a value.
- The upper and lower limits of the value entered from the ten-key pad are checked. If the value is not within the limits, the value is not written in the PLC and retry of the value entry is requested.
- Specify [next part name]. The cursor goes to the next "input numeral display" part. This function is useful for setting values continuously.
- The decimal point can be set at any digit when [position of point] is specified.
 Example) When [position of point] = 2: Connected device value "1234" → display value "12.34"

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [connected device name]		Enter the name of the device to which a value is to be written and displayed.
<input type="radio"/> [position of point]	0	Specify the position where the decimal point is to be displayed.
<input type="radio"/> [data listing lower:1/upper:2]	1	Specify the data of the first device of the 4 connected byte devices.
<input type="radio"/> [BIN:1, ±BIN:2/BCD:3]	2	Select the type of the connected device.
<input type="checkbox"/> [next part name]		Enter the name of the part to which the cursor is to be moved. If no next part exists, enter nothing.
<input type="radio"/> [input min. value]	0	Enter the lower limit value of input data.
<input type="radio"/> [input max. value]	1000000	Enter the upper limit value of input data.
<input type="checkbox"/> [screen name having ten-key pad]		Enter the name of the global screen when the ten-key pad is on a global screen. Enter nothing if the ten-key pad is on the self-screen.
<input checked="" type="radio"/> [ten-key pad name]		Enter the name of the ten-key pad.
<input type="checkbox"/> [self-screen:1/global screen: none]	1	Enter "1" when the ten-key pad is on the self-screen. Enter nothing when the ten-key pad is on a global screen.

■ Remark

- The [data listing lower/upper] specification is as shown below.
 Example) When "E100" is specified for [connected device]
 Lower: Input value "123" → "E100" value "123", "E101" to "E103" values "0"
 Upper: Input value "123" → "E100" value "0", "E101" to "E102" values "0", "E103" value "123"

3. CHARACTER DISPLAYS



Character displays	Registered text display	D: About 200 bytes
Registered text display		S: About 140 bytes

#CLM1001	#CLM1002	#CLM1003
#MLM1001	#MLM1002	#MLM1003
▬ ABCDEFGHI J ▬	▬ ABCDEFGHI J ▬	▬ ABCDEFGHI J ▬
#CLM1004	#CLM1005	#CLM1006
#MLM1004	#MLM1005	#MLM1006
▬ ABCDEFGHI J ▬	▬ ABCDEFGHI J ▬	ABCDEFGHI J
#CLM1007	#CLM1008	#CLM1009
#MLM1007	#MLM1008	#MLM1009
▬ ABCDEFGHI JKLMNOPQRST ▬	▬ ABCDEFGHI JKLMNOPQRST ▬	▬ ABCDEFGHI JKLMNOPQRST ▬
#CLM1010	#CLM1011	#CLM1012
#MLM1010	#MLM1011	#MLM1012
▬ ABCDEFGHI JKLMNOPQRST ▬	▬ ABCDEFGHI JKLMNOPQRST ▬	ABCDEFGHI JKLMNOPQRST

■ Function

- This part displays registered text according to the value of the connected device.
- The number of the registered text to display is decided by "connected device value" + "head No. of text".
- This part setup differs between "word device" and "bit device" to be connected.
 - [For word device]
 - Registered text is displayed according to the number corresponding to the value of the connected device.
 - [For bit device]
 - Registered text is displayed according to the offset number from the first device turned on. The first device is selected from "consecutive devices" started at the first connected device.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Character indicator setup]		
<input type="radio"/> [station No.]	01	Enter the name of the device that specifies the registered text number.
<input checked="" type="radio"/> [device name]		Enter the name of the device whose value is to be displayed. For a double-word device, enter the name of the first device.
<input type="radio"/> [continuous device]	1	Word device: Enter 1. Bit device: Enter the number of bit devices to be used.
<input type="radio"/> [data type]	BIN	Specify the type of each connected device.
<input type="radio"/> [head No. of text]	1	Enter the number of the first registered text to display.
<input type="radio"/> [color]	1 or 11	Specify the character color.

■ Remark

- The object text must be created and registered in advance.

3. Character Displays



Character displays ASCII text display	ASCII text display	D: About 520 bytes S: About 220 bytes
--	--------------------	--

#CLM2001 #MLM2001	#CLM2002 #MLM2002	#CLM2003 #MLM2003
ABCDEFGHIJ	ABCDEFGHIJ	ABCDEFGHIJ
#CLM2004 #MLM2004	#CLM2005 #MLM2005	#CLM2006 #MLM2006
ABCDEFGHIJ	ABCDEFGHIJ	ABCDEFGHIJ
#CLM2007 #MLM2007	#CLM2008 #MLM2008	#CLM2009 #MLM2009
ABCDEFGHIJKLMNQRST	ABCDEFGHIJKLMNQRST	ABCDEFGHIJKLMNQRST
#CLM2010 #MLM2010	#CLM2011 #MLM2011	#CLM2012 #MLM2012
ABCDEFGHIJKLMNQRST	ABCDEFGHIJKLMNQRST	ABCDEFGHIJKLMNQRST

■ Function

- This part regards characters read from the first connected device as ASCII code ones and displays the text.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [first device name]		Enter the name of the device from which characters are to be displayed.
<input type="radio"/> [number of characters (full size)]	5 or 10	Specify the number of word devices from which characters are to be read.
<input type="radio"/> [data listing lower:1/upper:2]	1	Specify the first character of the word device.

■ Remark

- Increase the number of characters to be controlled for display when it is more than the preset "number of characters read from PLC".
- The [data listing lower/upper] specification is as shown below.
Lower: Connected device value "4142H" → character display "BA"
Upper: Connected device value "4142H" → character display "AB"

3. Character Displays



Character displays	Input text display	D: About 1800 bytes
Input text display		S: About 330 bytes

#CLM3001 #MLM3001	#CLM3002 #MLM3002	#CLM3003 #MLM3003
ABCDEFGHI J	ABCDEFGHI J	ABCDEFGHI J
#CLM3004 #MLM3004	#CLM3005 #MLM3005	#CLM3006 #MLM3006
ABCDEFGHI J	ABCDEFGHI J	ABCDEFGHI J
#CLM3007 #MLM3007	#CLM3008 #MLM3008	#CLM3009 #MLM3009
ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST
#CLM3010 #MLM3010	#CLM3011 #MLM3011	#CLM3012 #MLM3012
ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST

■ Function

- This part regards characters read from the first connected device as ASCII code ones and displays the text.
- This part is combined with a "keyboard (input characters)" for use.
- Pressing this part opens the keyboard and the data entered from the keyboard is written in a PLC and displayed as characters.
- When "next part name" is specified, the cursor moves to the next input text part. This function is useful for specifying texts continuously.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [first device name]		Enter the name of the first device from which characters are to be written and displayed.
<input type="radio"/> [number of characters (full size)]	5 or 10	Specify the number of word devices from which characters are to be read.
<input type="radio"/> [data listing lower:1/upper:2]	1	Specify the first character of the word device.
<input type="radio"/> [display mode normal:1/fast: 2]	1	Specify the method for displaying the read bar-code text. "1": Displays a value after confirming that it is written in the PLC. "2": Displays a value before it is written in the PLC (fast display).
<input type="checkbox"/> [next part name]		Specify the name of the part to which the cursor is to be moved. Enter nothing when no next part exists.
<input type="checkbox"/> [screen name having keyboard]		Specify the name of the global screen when the keyboard is on a global screen. Enter nothing when the keyboard is on the self-screen.
<input checked="" type="radio"/> [keyboard name]		Specify the name of the keyboard.
<input type="checkbox"/> [self screen:1/global screen: none]	1	Enter "1" when the keyboard is on the self-screen. Enter nothing when the keyboard is on a global screen.


■ Remark

- Increase the number of characters to be controlled for display when it is more than the preset "number of characters read from PLC".
- The [data listing lower/upper] specification is as shown below.
Lower: Connected device value "4142H" → character display "BA"
Upper: Connected device value "4142H" → character display "AB"

3. Character Displays



Character displays Registered text display with scroll	Registered text display with scroll	D: About 2700 bytes S: About 1080 bytes
---	--	--

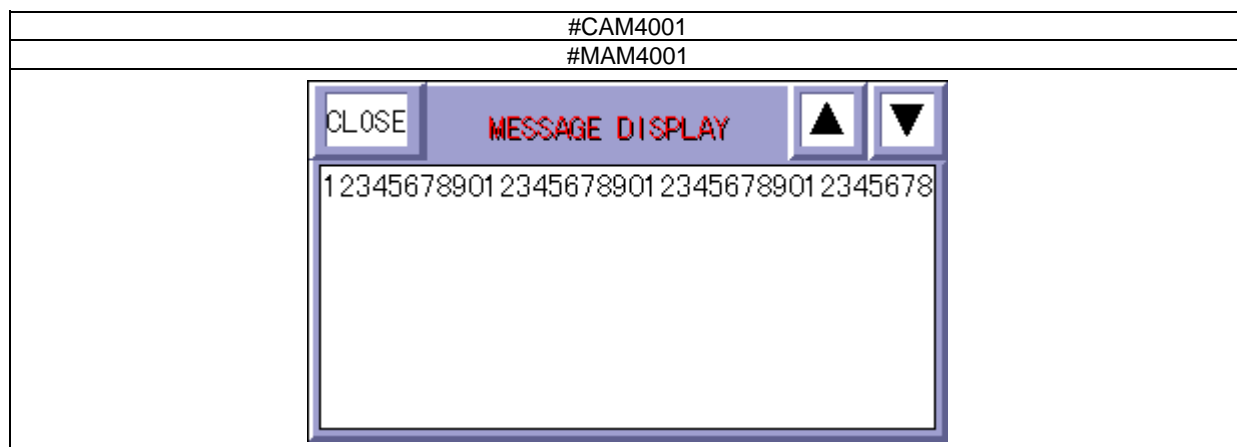

■ Function

- This part displays registered text corresponding to the data from another part.
- The number of the registered text to display is decided by "value sent to part" + "first registered text No.".
- Send data to this part using "PRINT" and "SEND" statements.
Example) PRINT 1 SEND .B000.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [first registered text No.]	1	Specify the first number of the registered text to display.

■ Remark

- The object text must be created and registered in advance.

3. Character Displays



Character displays Bar-code display	Bar-code display	D: About 280 bytes S: About 130 bytes
--	------------------	--

#CGM5001 #MGM5001	#CGM5002 #MGM5002	#CGM5003 #MGM5003
#CGM5004 #MGM5004	#CGM5005 #MGM5005	#CGM5006 #MGM5006
		ABCDEFGHI J
#CGM5007 #MGM5007	#CGM5008 #MGM5008	#CGM5009 #MGM5009
#CGM5010 #MGM5010	#CGM5011 #MGM5011	#CGM5012 #MGM5012
		ABCDEFGHI JKLMNOPQRST

■ Function

- This part displays the text read from a bar-code reader.

3. Character Displays



Character displays	Input bar-code display	D: About 1500 bytes
Input bar-code display		S: About 320 bytes

#CLM6301 #MLM6301	#CLM6302 #MLM6302	#CLM6303 #MLM6303
ABCDEF GHI J	ABCDEF GHI J	ABCDEF GHI J
#CLM6304 #MLM6304	#CLM6305 #MLM6305	#CLM6306 #MLM6306
ABCDEF GHI J	ABCDEF GHI J	ABCDEF GHI J
#CLM6307 #MLM6307	#CLM6308 #MLM6308	#CLM6309 #MLM6309
ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST
#CLM6310 #MLM6310	#CLM6311 #MLM6311	#CLM6312 #MLM6312
ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST

■ Function

- This character display displays a bar-code text and writes the text in a PLC as ASCII code data.
- Pressing the part enables bar-code data to be entered.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number.
<input checked="" type="radio"/> [first device name]		Enter the name of the first device in which the text is to be written.
<input type="radio"/> [number of characters (full size)]	5 or 10	Specify the number of byte devices in which data is to be written.
<input type="radio"/> [data listing lower:1/upper:2]	1	Specify the first character of the word device.
<input type="radio"/> [display mode normal:1/fast: 2]	1	Specify the method for displaying the read bar-code text. "1": Displays a value after confirming that it is written in the PLC. "2": Displays a value before it is written in the PLC (fast display).

■ Remark

- When the number of characters is more than the preset [number of characters], increase the number of characters for display controlling.
- The [data listing lower/upper] specification is as shown below.
Lower: Connected device value "4142H" → character display "BA"
Upper: Connected device value "4142H" → character display "AB"

3. Character Displays



Character displays ASCII text display (byte) dedicated to byte devices	ASCII text display (byte)	D: About 760 bytes S: About 260 bytes
--	---------------------------	--

#CLM6101 #MLM6101	#CLM6102 #MLM6102	#CLM6103 #MLM6103
ABCDEF GHI J	ABCDEF GHI J	ABCDEF GHI J
#CLM6104 #MLM6104	#CLM6105 #MLM6105	#CLM6106 #MLM6106
ABCDEF GHI J	ABCDEF GHI J	ABCDEF GHI J
#CLM6107 #MLM6107	#CLM6108 #MLM6108	#CLM6109 #MLM6109
ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST
#CLM6110 #MLM6110	#CLM6111 #MLM6111	#CLM6112 #MLM6112
ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST

■ Function

- This part is used only for a PLC having byte devices.
- This part regards characters read from the first connected device as ASCII code ones and displays them as a text.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [first device name]		Enter the name of the first device from which characters are to be displayed.
<input type="radio"/> [number of characters]	10 or 20	Specify the number of byte devices from which characters are to be read.

■ Remark

- Increase the number of characters to be controlled for display when it is more than the preset "number of characters read from PLC".

3. Character Displays



Character displays Input text display (byte) dedicated to byte devices	Input text display (byte)	D: About 1800 bytes S: About 400 bytes
#CLM6201 #MLM6201 ABCDEF GHI J	#CLM6202 #MLM6202 ABCDEF GHI J	#CLM6203 #MLM6203 ABCDEF GHI J
#CLM6204 #MLM6204 ABCDEF GHI J	#CLM6205 #MLM6205 ABCDEF GHI J	#CLM6206 #MLM6206 ABCDEF GHI J
#CLM6207 #MLM6207 ABCDEF GHI JKLMNOPQRST	#CLM6208 #MLM6208 ABCDEF GHI JKLMNOPQRST	#CLM6209 #MLM6209 ABCDEF GHI JKLMNOPQRST
#CLM6210 #MLM6210 ABCDEF GHI JKLMNOPQRST	#CLM6211 #MLM6211 ABCDEF GHI JKLMNOPQRST	#CLM6212 #MLM6212 ABCDEF GHI JKLMNOPQRST

■ Function

- This part is used only for a PLC having byte devices.
- This part regards characters read from the first connected device as ASCII code ones and displays them as a text.
- This part is combined with a "keyboard (input characters)" for use.
- Pressing this part opens the keyboard and the data entered from the keyboard is written in a PLC and displayed as characters.
- When "next part name" is specified, the cursor moves to the next input text part. This function is useful for specifying texts continuously.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	1	Enter the PLC station number.
<input checked="" type="radio"/> [first device name]		Enter the name of the first device from which characters are to be written and displayed.
<input type="radio"/> [number of characters]	10 or 20	Specify the number of byte devices from which characters are to be read.
<input type="radio"/> [display mode normal:1/fast: 2]	1	Specify the method for displaying the read bar-code text. "1": Displays a value after confirming that it is written in the PLC. "2": Displays a value before it is written in the PLC (fast display).
<input type="checkbox"/> [next part name]		Specify the name of the part to which the cursor is to be moved. Enter nothing when no next part exists.
<input type="checkbox"/> [screen name having keyboard]		Specify the name of the global screen when the keyboard is on a global screen. Enter nothing when the keyboard is on the self-screen.
<input checked="" type="radio"/> [keyboard name]		Specify the name of the keyboard.
<input type="checkbox"/> [self screen:1/global screen: none]	1	Enter "1" when the keyboard is on the self-screen. Enter nothing when the keyboard is on a global screen.











■ Remark

- Increase the number of characters to be controlled for display when it is more than the preset "number of characters" read from the PLC.

3. Character Displays



Character displays Input bar-code display (byte) dedicated for byte devices	Input bar-code display (byte)	D: About 1500 bytes S: About 320 bytes
---	----------------------------------	---

#CLM6301 #MLM6301 	#CLM6302 #MLM6302 	#CLM6303 #MLM6303 
#CLM6304 #MLM6304 	#CLM6305 #MLM6305 	#CLM6306 #MLM6306 ABCDEFGH I J
#CLM6307 #MLM6307 	#CLM6308 #MLM6308 	#CLM6309 #MLM6309 
#CLM6310 #MLM6310 	#CLM6311 #MLM6311 	#CLM6312 #MLM6312 ABCDEFGH I JKLMNOPQRST

■ Function

- This character display is dedicated for an PLC having byte devices.
- This character display displays a bar-code text and writes the text in a PLC as ASCII code data.
- Pressing the part enables bar-code data to be entered.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number.
<input checked="" type="radio"/> [first device name]		Enter the name of the first device in which the text is to be written.
<input type="radio"/> [number of characters]	10 or 20	Specify the number of byte devices in which data is to be written.
<input type="radio"/> [display mode normal: 1/fast: 2]	1	Specify the method for displaying the read bar-code text. "1": Displays a value after confirming that it is written in the PLC. "2": Displays a value before it is written in the PLC (fast display).

■ Remark

- When the number of characters is more than the preset [number of characters], increase the number of characters for display controlling.

4. LAMPS



Lamps LED	LED						D: About 160 bytes S: About 110 bytes
#CLL1001 #MLL1001	#CLL1002	#CLL1003	#CLL1004 #MLL1004	#CLL1005	#CLL1006	#CLL1007 #MLL1007	#CLL1008
#CLL1009	#CLL1010 #MLL1010	#CLL1011	#CLL1012	#CLL1013 #MLL1013	#CLL1014	#CLL1015	#CLL1016 #MLL1016
#CLL1017	#CLL1018	#CLL1019	#CLL1020 #MLL1020	#CLL1021	#CLL1022	#CLL1023 #MLL1023	#CLL1024
#CLL1025	#CLL1026 #MLL1026	#CLL1027	#CLL1028	#CLL1029 #MLL1029	#CLL1030	#CLL1031	#CLL1032 #MLL1032
#CLL1033	#CLL1034	#CLL1035 #MLL1035	#CLL1036	#CLL1037			

■ Function

- This part comes on when the connected device value is 1 and goes off when the value is 0.
- When this part is on, the “Color when OFF” in this part is changed to the “Color when ON”. (Color parts)

■ Operation parameters

Operation Parameter	Initial Value	Description
[Lamp setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device that turns on/off the lamp.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [Color when ON]	-	Specify the ON time color of the lamp.
<input type="radio"/> [Color when OFF]	-	Specify the OFF time color of the lamp. For a color part, change the color to be used in the part, as well.

■ Remark

- For a color part, the lamp does not come on unless the part is drawn with the same color as the “Color when OFF”.

4. Lamps



Lamps	Mark lamp	D: About 170 bytes
Mark lamp		S: About 110 bytes

#CLL2001	#CLL2002	#CLL2003	#CLL2004	#CLL2005	#CLL2006	#CLL2007	#CLL2008
#MLL2001	#MLL2002	#MLL2003	#MLL2004	#MLL2005	#MLL2006	#MLL2007	#MLL2008
#CLL2009	#CLL2010	#CLL2011	#CLL2012	#CLL2013	#CLL2014	#CLL2015	#CLL2016
#MLL2009	#MLL2010	#MLL2011	#MLL2012	#MLL2013	#MLL2014	#MLL2015	#MLL2016
#CLL2017	#CLL2018	#CLL2019	#CLL2020	#CLL2021	#CLL2022	#CLL2023	#CLL2024
#MLL2017	#MLL2018	#MLL2019	#MLL2020	#MLL2021	#MLL2022	#MLL2023	#MLL2024
#CLL2025	#CLL2026	#CLL2027	#CLL2028	#CLL2029	#CLL2030	#CLL2031	#CLL2032
#MLL2025	#MLL2026	#MLL2027	#MLL2028	#MLL2029	#MLL2030	#MLL2031	#MLL2032

■ Function

- This part comes on when the connected device value is 1 and goes off when the value is 0.
- When this part is on, the “Color when OFF” in this part is changed to the “Color when ON”. (Color parts)

■ Operation parameters

Operation Parameter	Initial Value	Description
[Lamp setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device that turns on/off the lamp.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [Color when ON]	-	Specify the ON time color of the lamp.
<input type="radio"/> [Color when OFF]	-	Specify the OFF time color of the lamp. For a color part, change the color to be used in the part, as well.

■ Remark

- For a color part, the lamp does not come on unless the part is drawn with the same color as the “Color when OFF”.

4. Lamps



Lamps	Name plate Lamp	D: About 190bytes S: About 110 bytes
Name plate Lamp		

#CLL3001	#CLL3002	#CLL3003	#CLL3004	#CLL3005	#CLL3006	#CLL3007	#CLL3008
#MLL3001	#MLL3002	#MLL3003	#MLL3004	#MLL3005	#MLL3006	#MLL3007	#MLL3008
	RUNNING	OPERATION	PROCESSING	STOP	STAND-BY	FORWARD	REVERSE
#CLL3009	#CLL3010	#CLL3011	#CLL3012	#CLL3013	#CLL3014	#CLL3015	#CLL3016
#MLL3009	#MLL3010	#MLL3011	#MLL3012	#MLL3013	#MLL3014	#MLL3015	#MLL3016
UP	DOWN	ROTATE	ACCELERATE	DECELERATE	ERROR	WARNING	CHECK
#CLL3017	#CLL3018	#CLL3019	#CLL3020	#CLL3021	#CLL3022	#CLL3023	#CLL3024
#MLL3017	#MLL3018	#MLL3019	#MLL3020	#MLL3021	#MLL3022	#MLL3023	#MLL3024
INSPECT	CARRY	STIR	STANDING	DISINFECT	WASH	DEHYDRATE	MEASURE
#CLL3025	#CLL3026	#CLL3027	#CLL3028	#CLL3029	#CLL3030	#CLL3031	#CLL3032
#MLL3025	#MLL3026	#MLL3027	#MLL3028	#MLL3029	#MLL3030	#MLL3031	#MLL3032
READ	WRITE	VALID	INVALID	CARRY-IN	CARRY-OUT	CAUTION	DANGER
#CLL3033	#CLL3034	#CLL3035	#CLL3036	#CLL3037	#CLL3038	#CLL3039	#CLL3040
#MLL3033	#MLL3034	#MLL3035	#MLL3036	#MLL3037	#MLL3038	#MLL3039	#MLL3040
WARM	COOL	HUMIDIFY	DEHUMIDIFY	HEAT	FREEZE	COMPRESS	DECOMPRESS

■ Function

- This part comes on when the connected device value is 1 and goes off when the value is 0.
- When this part is on, the “Color when OFF” in this part is changed to the “Color when ON”. (Color parts)

■ Operation parameters

Operation Parameter	Initial Value	Description
[Lamp setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device that turns on/off the lamp.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [Color when ON]	-	Specify the ON time color of the lamp.
<input type="radio"/> [Color when OFF]	-	Specify the OFF time color of the lamp. For a color part, change the “background color” of the part, as well.




■ Remark

- For a color part, the lamp does not come on unless the same color is used for both “background color” and the “Color when OFF” set for “Property of arrangement part”.




4. Lamps



Lamps	Name plate setup lamp	D: About 310 bytes
Name plate setup lamp		S: About 220 bytes

#CLL4001	#CLL4002	#CLL4003
#MLL4001	#MLL4002	#MLL4003
		

Lamps	Lamp with ON/OFF variable name plate	D: About 310 bytes
Name plate setup lamp		S: About 220 bytes

#CLL4004	#CLL4005	#CLL4005
#MLL4004	#MLL4005	#MLL4005
		

■ Function

- This part comes on when the connected device value is 1 and goes off when the value is 0.
- The name plate can be set up with “operation parameters”.
- When this part is on, the “Color when OFF” in this part is changed to the “Color when ON”. (Color parts)

■ Operation parameters

Operation Parameter	Initial Value	Description
[Lamp setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device that turns on/off the lamp.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [Color when ON]	-	Specify the ON time color of the lamp.
<input type="radio"/> [Color when OFF]	-	Specify the OFF time color of the lamp. For a color part, change the “background color” of the part, as well.

[Name plate setup lamp]

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [name plate character]	“Operate”	Enter the name plate characters to display.

[Lamp with ON/OFF variable name plate]

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [OFF time name plate character]	“OFF”	Enter the name plate characters to be displayed at OFF time.
<input type="radio"/> [ON time name plate character]	“ON”	Enter the name plate characters to be displayed at ON time.












■ Remark

- For a color part, the lamp does not come on unless the same color is used for both the “background color” and the “Color when OFF” set for “Property of arrangement part”.

4. Lamps



Lamps Piping lamp	Piping lamp	D: About 160 bytes S: About 130 bytes
----------------------	--------------------	--

#CLL5001	#CLL5002	#CLL5003	#CLL5004	#CLL5005	#CLL5006	#CLL5007	#CLL5008
#MLL5001	#MLL5002	#MLL5003	#MLL5004	#MLL5005	#MLL5006	#MLL5007	#MLL5008
							
#CLL5009	#CLL5010	#CLL5011					
#MLL5009	#MLL5010	#MLL5011					
							

■ **Function**

- This part comes on when the connected device value is 1 and goes off when the value is 0.

■ **Operation parameters**

Operation Parameter	Initial Value	Description
[Pipe setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device that turns on/off the pipe.
<input type="radio"/> [device type]	Word	Fixed to “word” (also for bit devices).
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.

■ **Remark**

- When changing the frame color and the ON/OFF time color of a pipe, use “Details edit” of the pipes.

4. Lamps



Lamps	Piping lamp	D: About 260 bytes
Piping lamp		S: About 110 bytes

#CLL5101	#CLL5102	#CLL5103	#CLL5104	#CLL5105	#CLL5106	#CLL5107	#CLL5108
#MLL5101	#MLL5102	#MLL5103	#MLL5104	#MLL5105	#MLL5106	#MLL5107	#MLL5108
#CLL5109	#CLL5110	#CLL5111	#CLL5112	#CLL5113	#CLL5114	#CLL5115	#CLL5116
#MLL5109	#MLL5110	#MLL5111	#MLL5112	#MLL5113	#MLL5114	#MLL5115	#MLL5116

■ Function

- This lamp (valve) comes on when the connected device value is 1 and goes off when the value is 0.
- When this lamp is turned on, the “Color when OFF” in the lamp is changed to the “Color when ON”. (Color parts)

■ Operation parameters

[Color parts]

Operation Parameter	Initial Value	Description
[Lamp setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device that turns on/off the lamp.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [Color when ON]	-	Specify the ON time color.
<input type="radio"/> [Color when OFF]	-	Specify the OFF time color. For a color part, change the color drawn in the part, as well.

[Monochrome parts]

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device that turns on/off the lamp.

■ Remark

- For a color part, the part is not turned on unless the same color as the “Color when OFF” is used in the part.

4. Lamps



Lamp For each bit of a word LED (for word)	LED(for each bit of a word device)	D: About 290 bytes S: About 110 bytes
--	---	--

#CLL6101	#CLL6102	#CLL6103	#CLL6104	#CLL6105	#CLL6106	#CLL6107	#CLL6108
#MLL6101			#MLL6104			#MLL6107	
#CLL6109	#CLL6110	#CLL6111	#CLL6112	#CLL6113	#CLL6114	#CLL6115	#CLL6116
	#MLL6110			#MLL6113			#MLL6116
#CLL6117	#CLL6118	#CLL6119	#CLL6120	#CLL6121	#CLL6122	#CLL6123	#CLL6124
			#MLL6120			#MLL6123	
#CLL6125	#CLL6126	#CLL6127	#CLL6128	#CLL6129	#CLL6130	#CLL6131	#CLL6132
	#MLL6126			#MLL6129			#MLL6132
#CLL6133	#CLL6134	#CLL6135	#CLL6136	#CLL6137			
		#MLL6135					

■ Function

- A LED lamp comes on for "1" and goes off for "0" set in a given bit of a connected word device respectively.
- When this LED lamp is turned on, the "Color when OFF" of "lamp control" in the part is changed to "Color when ON". (Color parts)

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name (word)]		Enter the name of the word device that turns ON/OFF the lamp.
<input type="radio"/> [bit position]		Specify the position (0-15) of the monitoring bit in the word device.

■ Remark

- For a color part, the lamp does not come on unless the part uses the same color as "Color when OFF" of "lamp control".

4. Lamps



Lamp For each bit of a word Mark lamp (for word)	Mark lamp (for each bit of a word device)	D: About 270 bytes S: About 110 bytes
--	--	--

#CLL6201	#CLL6202	#CLL6203	#CLL6204	#CLL6205	#CLL6206	#CLL6207	#CLL6208
#MLL6201	#MLL6202	#MLL6203	#MLL6204	#MLL6205	#MLL6206	#MLL6207	#MLL6208
#CLL6209	#CLL6210	#CLL6211	#CLL6212	#CLL6213	#CLL6214	#CLL6215	#CLL6216
#MLL6209	#MLL6210	#MLL6211	#MLL6212	#MLL6213	#MLL6214	#MLL6215	#MLL6216
#CLL6217	#CLL6218	#CLL6219	#CLL6220	#CLL6221	#CLL6222	#CLL6223	#CLL6224
#MLL6217	#MLL6218	#MLL6219	#MLL6220	#MLL6221	#MLL6222	#MLL6223	#MLL6224
#CLL6225	#CLL6226	#CLL6227	#CLL6228	#CLL6229	#CLL6230	#CLL6231	#CLL6232
#MLL6225	#MLL6226	#MLL6227	#MLL6228	#MLL6229	#MLL6230	#MLL6231	#MLL6232

■ Function

- This mark lamp comes on for "1" and goes off for "0" set in a given bit of a connected word device respectively.
- When this lamp is turned on, the "Color when OFF" of "lamp control" in the part is changed to "Color when ON". (Color parts)

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name (word)]		Enter the name of the word device that turns ON/OFF the lamp.
<input type="radio"/> [bit position]		Specify the position (0~15) of the monitoring bit in the word device.

■ Remark

- For a color part, the lamp does not come on unless the part uses the same color as "Color when OFF" of "lamp control".

4. Lamps



Lamp For each bit of a word Name plate lamp(for word)	Name plate lamp (for each bit of a word device)	D: About 400 bytes S: About 110 bytes
---	--	--

#CLL6301	#CLL6302	#CLL6303	#CLL6304	#CLL6305	#CLL6306	#CLL6307	#CLL6308
#MLL6301	#MLL6302	#MLL6303	#MLL6304	#MLL6305	#MLL6306	#MLL6307	#MLL6308
#CLL6309	#CLL6310	#CLL6311	#CLL6312	#CLL6313	#CLL6314	#CLL6315	#CLL6316
#MLL6309	#MLL6310	#MLL6311	#MLL6312	#MLL6313	#MLL6314	#MLL6315	#MLL6316
#CLL6317	#CLL6318	#CLL6319	#CLL6320	#CLL6321	#CLL6322	#CLL6323	#CLL6324
#MLL6317	#MLL6318	#MLL6319	#MLL6320	#MLL6321	#MLL6322	#MLL6323	#MLL6324
#CLL6325	#CLL6326	#CLL6327	#CLL6328	#CLL6329	#CLL6330	#CLL6331	#CLL6332
#MLL6325	#MLL6326	#MLL6327	#MLL6328	#MLL6329	#MLL6330	#MLL6331	#MLL6332
#CLL6333	#CLL6334	#CLL6335	#CLL6336	#CLL6337	#CLL6338	#CLL6339	#CLL6340
#MLL6333	#MLL6334	#MLL6335	#MLL6336	#MLL6337	#MLL6338	#MLL6339	#MLL6340

■ Function

- This lamp comes on for "1" and goes off for "0" set in a given bit of a connected word device respectively.
- When this part is turned on, the "Color when OFF" of "lamp control" in the part is changed to "Color when ON". (Color parts)

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name (word)]		Enter the name of the word device that turns ON/OFF the lamp.
<input type="radio"/> [bit position]		Specify the position (0-15) of the monitoring bit in the word device.

■ Remark

- For a color part, the lamp does not come on unless the part uses the same color as "Color when OFF" of "lamp control".

5. SWITCHES



Switches	Mark switch	D: About 210 bytes
Mark switch		S: About 150 bytes

#CLS1001	#CLS1002	#CLS1003	#CLS1004	#CLS1005	#CLS1006	#CLS1007	#CLS1008
#MLS1001		#MLS1003	#MLS1004	#MLS1005	#MLS1006	#MLS1007	#MLS1008
#CLS1009	#CLS1010	#CLS1011	#CLS1012	#CLS1013	#CLS1014	#CLS1015	#CLS1016
#MLS1009	#MLS1010	#MLS1011	#MLS1012	#MLS1013	#MLS1014	#MLS1015	#MLS1016
#CLS1017	#CLS1018	#CLS1019	#CLS1020	#CLS1021	#CLS1022	#CLS1023	#CLS1024
#MLS1017	#MLS1018	#MLS1019	#MLS1020	#MLS1021	#MLS1022	#MLS1023	#MLS1024
#CLS1025	#CLS1026	#CLS1027	#CLS1028	#CLS1029	#CLS1030	#CLS1031	#CLS1032
#MLS1025	#MLS1026	#MLS1027	#MLS1028	#MLS1029	#MLS1030	#MLS1031	#MLS1032

■ Function

- This switch sends its ON/OFF status to the connected device.
- This switch is a momentary one. To change the switch type to an alternate one, change "TYPE" to "Alternate" in "Details edit" of the switches.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Switch setting]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device in which the switch ON/OFF status is to be written.
<input type="radio"/> [synchronize and operate]	None	YES: Changes the display according to the switch ON/OFF status. NO: Changes the display by confirming that the PLC value is changed.
<input type="radio"/> [Write when ON]	1	Enter the value to be written at ON time.
<input type="radio"/> [Write when OFF]	0	Enter the value to be written at OFF time.

■ Remark

- To change the ON time display color, change "Background : Color when ON" with "Details edit" of the switches.
- To change the OFF time display color, change "Background : Color when OFF" with "Details edit" of the switches, then change the part color or the "background color" set in "Property of arrangement parts" to the same color.



Switches	Mark switch	D: About 210 bytes
Mark switch		S: About 150 bytes

#CLS1033	#CLS1034	#CLS1035	#CLS1036	#CLS1037	#CLS1038	#CLS1039	#CLS1040
#MLS1033	#MLS1034	#MLS1035	#MLS1036	#MLS1037	#MLS1038	#MLS1039	#MLS1040
#CLS1041	#CLS1042	#CLS1043	#CLS1044	#CLS1045	#CLS1046	#CLS1047	#CLS1048
#MLS1041	#MLS1042	#MLS1043	#MLS1044				
#CLS1049							
#MLS1049							

■ Function

- This switch sends its ON/OFF status to the connected device.
- This switch is a momentary one. To change the switch type to an alternate one, change "TYPE" to "Alternate" in "Details edit" of the switches.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Switch setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device in which the switch ON/OFF status is to be written.
<input type="radio"/> [synchronize and operate]	None	YES: Changes the display according to the switch ON/OFF status. NO: Changes the display by confirming that the PLC value is changed.
<input type="radio"/> [Write when ON]	1	Enter the value to be written at ON time.
<input type="radio"/> [Write when OFF]	0	Enter the value to be written at OFF time.

■ Remark

- To change the ON time display color, change "Background : Color when ON" with "Details edit" of the switches.
- To change the OFF time display color, change "Background : Color when OFF" with "Details edit" of the switches, then change the part color or the "background color" set in "Property of arrangement parts" to the same color.

5. Switches



Switches	Mark switch with monitor	D: About 260 bytes
Mark switch with monitor		S: About 180 bytes

#CLS2001	#CLS2002	#CLS2003	#CLS2004	#CLS2005	#CLS2006	#CLS2007	#CLS2008
#MLS2001		#MLS2003	#MLS2004	#MLS2005	#MLS2006	#MLS2007	#MLS2008
#CLS2009	#CLS2010	#CLS2011	#CLS2012	#CLS2013	#CLS2014	#CLS2015	#CLS2016
#MLS2009	#MLS2010	#MLS2011	#MLS2012	#MLS2013	#MLS2014	#MLS2015	#MLS2016
#CLS2017	#CLS2018	#CLS2019	#CLS2020	#CLS2021	#CLS2022	#CLS2023	#CLS2024
#MLS2017	#MLS2018	#MLS2019	#MLS2020	#MLS021	#MLS2022	#MLS2023	#MLS2024
#CLS2025	#CLS2026	#CLS2027	#CLS2028	#CLS2029	#CLS2030	#CLS2031	#CLS2032
#MLS2025	#MLS2026	#MLS2027	#MLS2028	#MLS2029	#MLS2030	#MLS2031	#MLS2032

■ Function

- This switch sends its ON/OFF status to the connected device and displays the ON/OFF status according to the status change of the lamp connected device.
- This switch is a momentary one. To change the switch type to an alternate one, change "TYPE" to "Alternate" with "Details edit" of the switches.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Lamp setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device that turns ON/OFF the lamp display.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [Color when ON]	-	Specify the ON time color.
<input type="radio"/> [Color when OFF]	-	Specify the OFF time color. For a color part, change the part color, as well.

Operation Parameter	Initial Value	Description
[Switch setting]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device in which the switch ON/OFF status is to be written.
<input type="radio"/> [synchronize and operate]	None	Fixed to "NO".
<input type="radio"/> [Write when ON]	1	Enter the value to be written at ON time.
<input type="radio"/> [Write when OFF]	-	Enter the value to be written at OFF time.

■ Remark

- For a color part, the part is not turned on unless the part is drawn with the same color as that of the "Color when OFF" set for "lamp setup".



Switches	Mark switch with monitor	D: About 260 bytes S: About 180 bytes
----------	---------------------------------	--

#CLS2033	#CLS2034	#CLS2035	#CLS2036	#CLS2037	#CLS2038	#CLS2039	#CLS2040
#MLS2033	#MLS2034	#MLS2035	#MLS2036	#MLS2037	#MLS2038	#MLS2039	#MLS2040
#CLS2041	#CLS2042	#CLS2043	#CLS2044	#CLS2045	#CLS2046	#CLS2047	#CLS2048
#MLS2041	#MLS2042	#MLS2043	#MLS2044				
#CLS2049	#CLS2050						
#MLS2049	#MLS2050						

■ Function

- This switch sends its ON/OFF status to the connected device and displays the ON/OFF status according to the status change of the lamp connected device.
- This switch is a momentary one. To change the switch type to an alternate one, change "TYPE" to "Alternate" with "Details edit" of the switches.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Lamp setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device that turns ON/OFF the lamp display.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [Color when ON]	-	Specify the ON time color.
<input type="radio"/> [Color when OFF]	-	Specify the OFF time color. For a color part, change the part color, as well.

Operation Parameter	Initial Value	Description
[Switch setting]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device in which the switch ON/OFF status is to be written.
<input type="radio"/> [synchronize and operate]	None	Fixed to "NO".
<input type="radio"/> [Write when ON]	1	Enter the value to be written at ON time.
<input type="radio"/> [Write when OFF]	-	Enter the value to be written at OFF time.

■ Remark

- For a color part, the part is not turned on unless the part is drawn with the same color as that of the "Color when OFF" set for "lamp setup".

5. Switches



Switches	Name plate switch	D: About 220 bytes
Name plate switch		S: About 150 bytes

#CLS3001	#CLS3002	#CLS3003	#CLS3004	#CLS3005	#CLS3006	#CLS3007	#CLS3008
#MLS3001	#MLS3002	#MLS3003	#MLS3004	#MLS3005	#MLS3006	#MLS3007	#MLS3008
#CLS3009	#CLS3010	#CLS3011	#CLS3012	#CLS3013	#CLS3014	#CLS3015	#CLS3016
#MLS3009	#MLS3010	#MLS3011	#MLS3012	#MLS3013	#MLS3014	#MLS3015	#MLS3016
#CLS3017	#CLS3018	#CLS3019	#CLS3020	#CLS3021	#CLS3022	#CLS3023	#CLS3024
#MLS3017	#MLS3018	#MLS3019	#MLS3020	#MLS3021	#MLS3022	#MLS3023	#MLS3024

■ **Function**

- This switch sends its ON/OFF status to the connected device.
- This switch is a momentary one. To change the switch type to an alternate one, change "TYPE" to "Alternate" with "Details edit" of the switches.

■ **Operation parameters**

Operation Parameter	Initial Value	Description
[Switch setting]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device in which the switch ON/OFF status is to be written.
<input type="radio"/> [synchronize and operate]	None	YES: Changes the display according to the switch ON/OFF status. NO: Changes the display by confirming that the PLC value is changed.
<input type="radio"/> [Write when ON]	1	Enter the value to be written at ON time.
<input type="radio"/> [Write when OFF]	0	Enter the value to be written at OFF time.

■ **Remark**

- To change the ON time display color, change "Background : Color when ON" with "Details edit" of the switches.
- To change the OFF time display color, change "Background : Color when OFF" with "Details edit" of the switches, then change the part color or the "background color" set for "Property of arrangement parts" to the same color.

5. Switches



Switches	Name plate switch	D: About 220 bytes
Name plate switch		S: About 150 bytes

#CLS3025	#CLS3026	#CLS3027	#CLS3028	#CLS3029	#CLS3030	#CLS3031	#CLS3032
#MLS3025	#MLS3026	#MLS3027	#MLS3028	#MLS3029	#MLS3030	#MLS3031	#MLS3032
RIGHT	LEFT	OPEN	CLOSE	↑	↓	←	→
#CLS3033	#CLS3034	#CLS3035	#CLS3036	#CLS3037	#CLS3038	#CLS3039	#CLS3040
#MLS3033	#MLS3034	#MLS3035	#MLS3036	#MLS3037	#MLS3038	#MLS3039	#MLS3040
INSPECT	CHECK	CARRY-IN	CARRY-OUT	ON	OFF	COM-PRESS	DECOM-PRESS
#CLS3041	#CLS3042	#CLS3043	#CLS3044	#CLS3045	#CLS3046	#CLS3047	#CLS3048
#MLS3041	#MLS3042	#MLS3043	#MLS3044	#MLS3045	#MLS3046	#MLS3047	#MLS3048
COMPRESS	DECOM-PRESS	WARM	COOL	HUMIDIFY	DEHUMI-DIFY	HEAT	FREEZE

■ Function

- This switch sends its ON/OFF status to the connected device.
- This switch is a momentary one. To change the switch type to an alternate one, change "TYPE" to "Alternate" with "Details edit" of the switches.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Switch setting]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device in which the switch ON/OFF status is to be written.
<input type="radio"/> [synchronize and operate]	None	YES: Changes the display according to the switch ON/OFF status. NO: Changes the display by confirming that the PLC value is changed.
<input type="radio"/> [Write when ON]	1	Enter the value to be written at ON time.
<input type="radio"/> [Write when OFF]	0	Enter the value to be written at OFF time.

■ Remark

- To change the ON time display color, change "Background : Color when ON" with "Details edit" of the switches.
- To change the OFF time display color, change "Background : Color when OFF" with "Details edit" of the switches, then change the part color or the "background color" set for "Property of arrangement parts" to the same color.

5. Switches



Switches	Name plate switch with monitor	D: About 270 bytes S: About 180 bytes
Name plate switch with monitor		

#CLS4001	#CLS4002	#CLS4003	#CLS4004	#CLS4005	#CLS4006	#CLS4007	#CLS4008
#MLS4001	#MLS4002	#MLS4003	#MLS4004	#MLS4005	#MLS4006	#MLS4007	#MLS4008
#CLS4009	#CLS4010	#CLS4011	#CLS4012	#CLS4013	#CLS4014	#CLS4015	#CLS4016
#MLS4009	#MLS4010	#MLS4011	#MLS4012	#MLS4013	#MLS4014	#MLS4015	#MLS4016
#CLS4017	#CLS4018	#CLS4019	#CLS4020	#CLS4021	#CLS4022	#CLS4023	#CLS4024
#MLS4017	#MLS4018	#MLS4019	#MLS4020	#MLS4021	#MLS4022	#MLS4023	#MLS4024

■ Function

- This switch sends its ON/OFF status to the connected device and displays the ON/OFF status according to the status change of the lamp connected device.
- This switch is a momentary one. To change the switch type to an alternate one, change "TYPE" to "ALTERNATE" in "Details edit" of the switches.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Lamp setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device that turns ON/OFF the lamp display.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [Color when ON]	-	Specify the ON time color.
<input type="radio"/> [Color when OFF]	-	Specify the OFF time color. For a color part, change the part color, as well.

Operation Parameter	Initial Value	Description
[Switch setting]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device in which the switch ON/OFF status is to be written.
<input type="radio"/> [synchronize and operate]	None	Fixed to "NO".
<input type="radio"/> [Write when ON]	1	Enter the value to be written at ON time.
<input type="radio"/> [Write when OFF]	-	Enter the value to be written at OFF time.

■ Remark

- Change both the "Color when OFF" of "lamp setting" and the "background color" of "Property of arrangement parts" to the same color.

5. Switches



Switches	Name plate switch with monitor	D: About 270 bytes S: About 180 bytes
Name plate switch with monitor		

#CLS4025	#CLS4026	#CLS4027	#CLS4028	#CLS4029	#CLS4030	#CLS4031	#CLS4032
#MLS4025	#MLS4026	#MLS4027	#MLS4028	#MLS4029	#MLS4030	#MLS4031	#MLS4032
RIGHT	LEFT	OPEN	CLOSE	↑	↓	←	→
#CLS4033	#CLS4034	#CLS4035	#CLS4036	#CLS4037	#CLS4038	#CLS4039	#CLS4040
#MLS4033	#MLS4034	#MLS4035	#MLS4036	#MLS4037	#MLS4038	#MLS4039	#MLS4040
INSPECT	CHECK	CARRY-IN	CARRY-OUT	ON	OFF	COM-PRESS	DECOM-PRESS
#CLS4041	#CLS4042	#CLS4043	#CLS4044	#CLS4045	#CLS4046	#CLS4047	#CLS4048
#MLS4041	#MLS4042	#MLS4043	#MLS4044	#MLS4045	#MLS4046	#MLS4047	#MLS4048
COMPRESS	DECOM-PRESS	WARM	COOL	HUMIDIFY	DEHUMI-DIFY	HEAT	FREEZE

■ Function

- This switch sends its ON/OFF status to the connected device and displays the ON/OFF status according to the status change of the lamp connected device.
- This switch is a momentary one. To change the switch type to an alternate one, change "TYPE" to "Alternate" with "Details edit" of the switches.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Lamp setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device that turns ON/OFF the lamp display.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [Color when ON]	-	Specify the ON time color.
<input type="radio"/> [Color when OFF]	-	Specify the OFF time color. For a color part, change the "background color", as well.

Operation Parameter	Initial Value	Description
[Switch setting]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device in which the switch ON/OFF status is to be written.
<input type="radio"/> [synchronize and operate]	None	Fixed to "NO".
<input type="radio"/> [Write when ON]	1	Enter the value to be written at ON time.
<input type="radio"/> [Write when OFF]	0	Enter the value to be written at OFF time.

■ Remark

- Change both the "Color when OFF" of "lamp setting" and the "background color" of "Property of arrangement parts" to the same color.

5. Switches



Switches Toggle/selector	Toggle switch	D: About 690 bytes S: About 260 bytes
-----------------------------	----------------------	--

#CLS5001	#CLS5002	#CLS5003	#CLS5004	#CLS5005	#CLS5006	#CLS5007	#CLS5008
#MLS5001	#MLS5002	#MLS5003	#MLS5004	#MLS5005	#MLS5006	#MLS5007	#MLS5008
#CLS5009	#CLS5010	#CLS5011	#CLS5012	#CLS5013	#CLS5014	#CLS5015	#CLS5016
#MLS5009	#MLS5010	#MLS5011	#MLS5012	#MLS5013	#MLS5014	#MLS5015	#MLS5016
#CLS5017							
#MLS5017							

■ **Function**

- This switch sends its ON/OFF status to the connected device and displays the ON/OFF status according to the change of the monitor connected device.

■ **Operation parameters**

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [monitor connected device name]		Enter the name of the device on which the switch ON/OFF status is to be displayed.
<input checked="" type="radio"/> [switch connected device name]		Enter the name of the device in which the switch ON/OFF status is to be written.



Switches Toggle/selector	Selector switch	D: Refer to the table S: Refer to the table
-----------------------------	------------------------	--

#CLS5101	#CLS5102	#CLS5103
#MLS5101	#MLS5102	#MLS5103
Radio switch	Selector switch	Selector switch (Mitsubishi CPU direct connection)
D: About 980 bytes S: About 490 bytes	D: About 470 bytes S: About 340 bytes	D: About 1520 bytes S: About 560 bytes
<input type="radio"/> SETUP1 <input type="radio"/> SETUP2 <input type="radio"/> SETUP3	<input type="radio"/> SETUP1 <input type="radio"/> SETUP2 <input type="radio"/> SETUP3	<input type="radio"/> SETUP1 <input type="radio"/> SETUP2 <input type="radio"/> SETUP3

■ Function

[Radio switch]

- Only one of the 3 switches can be turned on. (Impossible to turn off all those 3 switches at once.)
- This part writes the turned-on switch number in a PLC.

[Selector switch]

- Only one of the 3 switches can be turned on. (Possible to turn off all those 3 switches at once.)
- This part writes the turned-on switch number in a PLC when “Word” is set for “device type”.
- When “Bit” is set for “device type”, this part writes “1” in the bit device of the switch number started at the connected “device name”.

[Selector switch (Mitsubishi CPU direct connection)]

- This part is used when “Mitsubishi CPU direct connection” is specified and “Bit” is set for “device type” of the above selector switch.

■ Operation parameters

[Radio switch]

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [switch connected device name]		Enter the name of the word device in which the switch ON number is to be written.

[Selector switch]

Operation Parameter	Initial Value	Description
[Selector switch setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device in which the switch ON/OFF status is to be written.
<input type="radio"/> [device type]	Word	Refer to “Function” described above.
<input type="radio"/> [synchronize and operate]	Yes	NO: Changes the display according to the switch ON/OFF status. YES: Changes the display by confirming that the PLC value is changed.

[Selector switch (Mitsubishi CPU direct connection)]

Operation Parameter	Initial Value	Description
[Selector switch setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [switch connected device name]		Enter the name of the first bit device in which the switch ON number is to be written.
<input type="radio"/> [number of switches]	3	Specify the number of switches.





6. TEN-KEY PADS AND KEYBOARDS





Ten-key pads/keyboards
Ten-key pad (for input numeral display)

**Ten-key
(for input numeral display)**

D: Refer to the table
S: Refer to the table
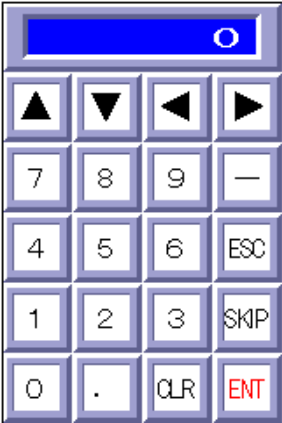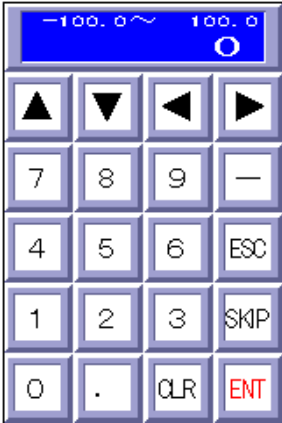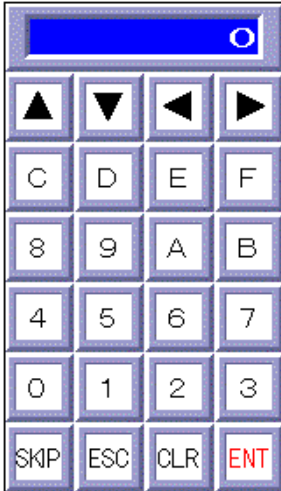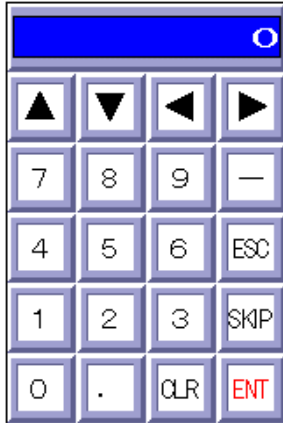
#CLT1001 #MLT1001	#CLT1002 #MLT1002	#CLT1003 #MLT1003	#CLT1004 #MLT1004
Ten-key pad	Ten-key pad with upper and lower indicators	Hexadecimal ten-key pad	Ten-key pad (double words)
D: About 4600 bytes S: About 1500 bytes	D: About 4700 bytes S: About 1700 bytes	D: About 4300 bytes S: About 1700 bytes	D: About 4600 bytes S: About 1500 bytes
			
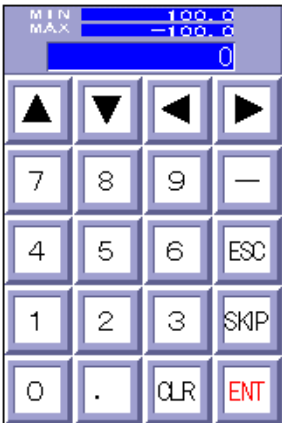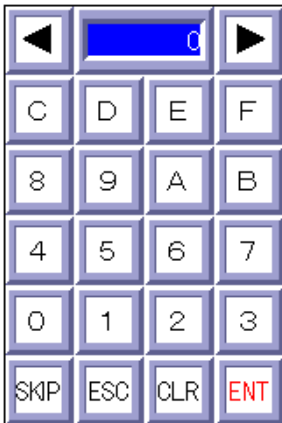
#CLT1005 #MLT1005	#CLT1006 #MLT1006
Ten-key pad with upper and lower indicators (double words)	Hexadecimal ten-key pad
D: About 4700 bytes S: About 1700 bytes	D: About 4300 bytes S: About 1700 bytes
	

■ Function

- This part is combined with an “input numeral display” part for use.
- The part must be closed when arranged on a screen. Pressing the “input numeral display” part opens this part automatically.
- This part checks the upper and lower limit values set for the “input numeral display” part.

[Key operation]

[ENT]: Used to transfer an entered value to the “input numeral display” part.

[ESC]: Used to stop an input operation and closes the ten-key pad.

[CLR]: Used to clear the value displayed on the ten-key pad.

[SKIP]: Used to stop the “input numeral display” part to which data is being entered and begins an entry of data for “next part”.

6. Ten-key Pads and Keyboards



Ten-key pads/keyboards Keyboard (for input text display)	Keyboard (for input text display)	D: Refer to the table S: Refer to the table
---	--	--

#CLT2001 #MLT2001	#CLT2002 #MLT2002
Alphanumeral & symbol keyboard	Full keyboard
D: About 8500 bytes S: About 3100 bytes	D: About 12000 bytes S: About 3800 bytes

■ **Function**

- This part is combined with an “input text display” part for use.
- The part must be closed when arranged on a screen. Pressing the “input text display” part opens this part automatically.

[Key operation]

[ENT]: Used to transfer entered values to the “input text display” part.

[ESC]: Used to stop an input operation and closes the ten-key pad.

[SKIP]: Used to stop the “input text display” part to which data is being entered and begins an entry of data for “next part”.

6. Ten-key Pads and Keyboards



Ten-key pads/keyboards Keyboard (for input text display)	Keyboard (for input text display)	D: Refer to the table S: Refer to the table
---	--	--

#CLT2004	#CLT2005
#MLT2004	#MLT2005
Alphanumerics & symbols keyboard (medium)	Alphanumerics & symbols keyboard (medium)
D: About 7000 bytes S: About 2300 bytes	D: About 7000 bytes S: About 2300 bytes

- **Function**
 - This part is combined with an "input text display" part for use.
 - This part must be closed when arranged on a screen. Pressing an "input text display" part opens this part automatically.

[Key operation]






[ENT]: Used to transfer an input text to an "input text display" part.

[ESC]: Used to stop the current input work and closes the keyboard.

[SKIP]: Used to stop the "input text display" part in which data is being entered currently and begins the input of "next item part".

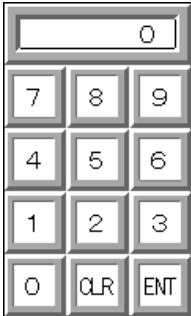

Ten-key pads/keyboards	Ten-key pad/volume (direct write)	D: Refer to the table S: Refer to the table
Ten-key pad/volume (direct write)		

#CLT3001 #MLT3001 Ten-key pad D: About 2300 bytes S: About 920 bytes	#CLT3002 #MLT3002 Volume D: About 1500 bytes S: About 370 bytes	#CLT3003 #MLT3003 Bar volume D: About 2500 bytes S: About 960 bytes
		
#CLT3004 #MLT3004 Bar volume D: About 2500 bytes S: About 960 bytes	#CLT3005 #MLT3005 Rotate type volume D: About 1800 bytes S: About 510 bytes	
		

- **Function**
 - When pressing [ENT] after a value is set, this part writes the value in the connected device.

■ **Operation parameters**
[Common setting]

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number.
<input checked="" type="radio"/> [connected device name]		Enter the name of the device in which the set value is to be written.
<input type="radio"/> [BIN:1, ±BIN:2/BCD:3]	1 or 2	Specify the type of the connected device.

[Other setting]

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [min value]	0	Enter the lower limit value of input data.
<input checked="" type="radio"/> [max value]	-	Enter the upper limit value of input data.
<input type="radio"/> [increment value]	1	Enter the value to be increased/decreased at a switch entry.
<input type="radio"/> [correction coefficient A]	1	((input data - [data correction offset B])/[data correction coefficient A]) decides the value to be written in PLC.
<input type="radio"/> [correction offset value B]	0	

7. SCREEN SELECT PARTS



Screen select parts	Screen select switch	D: About 310 bytes
Screen select switch		S: About 140 bytes

#CAB1001	#CAB1002	#CAB1003	#CAB1004	#CAB1005	#CAB1006	#CAB1007	#CAB1008
#MAB1001	#MAB1002	#MAB1003	#MAB1004	#MAB1005	#MAB1006	#MAB1007	#MAB1008
	MENU	BACK	NEXT	RETURN	END	MANUAL	AUTO
#CAB1009	#CAB1010	#CAB1011	#CAB1012	#CAB1013	#CAB1014	#CAB1015	#CAB1016
#MAB1009	#MAB1010	#MAB1011	#MAB1012	#MAB1013	#MAB1014	#MAB1015	#MAB1016
MONITOR	MAIN	RUN	OPERATION	INSPECT	MANAGE	ERROR	WARNING
#CAB1017	#CAB1018	#CAB1019	#CAB1020				
#MAB1017	#MAB1018	#MAB1019	#MAB1020				
SETUP	SETUP END	BACK PAGE	NEXT PAGE				

- Function
 - This switch displays a specified screen.

- Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
© [next screen name]		Enter the name of the next screen.

7. Screen Select Parts



Screen select parts Screen select switch (notice type)	Screen select switch (notice type)	D: About 440 bytes S: About 150 bytes
---	---	--

#CLB2001	#CLB2002	#CLB2003	#CLB2004	#CLB2005	#CLB2006	#CLB2007	#CLB2008
#MLB2001	#MLB2002	#MLB2003	#MLB2004	#MLB2005	#MLB2006	#MLB2007	#MLB2008
	MENU	BACK	NEXT	RETURN	END	MANUAL	AUTO
#CLB2009	#CLB2010	#CLB2011	#CLB2012	#CLB2013	#CLB2014	#CLB2015	#CLB2016
#MLB2009	#MLB2010	#MLB2011	#MLB2012	#MLB2013	#MLB2014	#MLB2015	#MLB2016
MONITOR	MAIN	RUN	OPERATION	INSPECT	MANAGE	ERROR	WARNING
#CLB2017	#CLB2018	#CLB2019	#CLB2020				
#MLB2017	#MLB2018	#MLB2019	#MLB2020				
SETUP	SETUP END	BACK PAGE	NEXT PAGE				

■ Function

- This switch displays the specified screen and notifies the connected device of the displayed screen number.
- This switch can also be used together with a “screen select control part” arranged on a global screen.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [next screen name]		Enter the name of the next screen.
<input type="radio"/> [BIN:1, ±BIN:2/BCD:3]	1	Specify the type of the connected device.
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device to which the selected screen number is to be notified.
<input type="radio"/> [control part usage YES:1/NO:0]	0	Specify whether or not the “screen select control part” is used.

■ Remark

- To use this switch together with a “screen select control part”, the screen is changed by the “screen select control part”.

7. Screen Select Parts



Screen select parts	Screen select control part	D: About 240 bytes
Screen select control part		S: About 80 bytes

#CLB3001
#MLB3001
(No pattern is used.)

■ Function

- This part selects a screen according to the connected device value.
- This part must be closed when arranged on a global screen.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	0	Enter the name of the next screen.
<input checked="" type="radio"/> [device name]		Enter the name of the device that changes the screen.
<input type="radio"/> [BIN:1, ±BIN:2/BCD:3]	0	Specify the type of the connected device.

■ Remark

- The screen select number is assumed as a registered screen number.



Screen select part	Screen select part with PIN	D: About 2400 bytes
Screen select control part		S: About 1100 bytes

#CAB3101
#MAB3101

■ Function

- This part displays the specified screen according to the entered PIN (personal identification number).
- This part is closed when the screen is changed if it is movably arranged on the screen.
- This part is closed when movably arranged on a screen if a wrong PIN is entered 3 times consecutively.







■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [PIN]	"1234"	Specify the PIN (personal identification number).
<input checked="" type="radio"/> [next screen name]		Enter the next screen to display.

8. METERS



Meters	Analog meter	D: About 300 bytes
Analog meter		S: About 140 bytes

#CLE1001 #MLE1001	#CLE1002 #MLE1002	#CLE1003 #MLE1003
		
#CLE1004 #MLE1004	#CLE1005 #MLE1005	#CLE1006 #MLE1006
		

■ Function

- This meter displays the value of the connected device.
- The range, pointer color, pointer thickness, etc. of this meter can be changed with “Details edit” of the meters.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Meter setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device whose value is to be displayed on the meter.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="checkbox"/> [filter]		Specify this parameter to display a corrected value of the connected device.



Meters	Bar meter	D: About 160 bytes
Bar meter		S: About 160 bytes

#CLE2001 #MLE2001	#CLE2003 #MLE2003	#CLE2004 #MLE2004	#CLE2007 #MLE2007	#CLE2008 #MLE2008
#CLE2002 #MLE2002	#CLE2005 #MLE2005		#CLE2006 #MLE2006	
#CLE2009 #MLE2009	#CLE2010 #MLE2010			

■ Function

- This meter displays the value of the connected device.
- The range, bar color, etc. of the meter can be changed with “Details edit” of the bar graphs.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Bar graph setup]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device whose value is to be displayed on the bar meter.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [sampling time]	0	Fixed to “0”.
<input type="checkbox"/> [filter]		Set this parameter to display a corrected value of the connected device.
<input type="radio"/> [bar piece]	1	Fixed to “1”.
<input type="radio"/> [bar dot]	25	Enter the number of dots as the width of the bar.



Meters	Slide meter	D: About 230 bytes
Slide meter		S: About 140 bytes

#CLE3001 #MLE3001	#CLE3003 #MLE3003	#CLE3004 #MLE3004
#CLE3002 #MLE3002	#CLE3005 #MLE3005	#CLE3006 #MLE3006

■ Function









- This meter displays the value of the connected device.
- The range, etc. of the meter can be changed with “Details edit” of the sliders.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Slider setup]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device whose value is to be displayed on the slide meter.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="checkbox"/> [filter]		Specify this parameter to display a corrected value of the connected device.



Meters	Free meter	D: About 330 bytes
Free meter		S: About 130 bytes

#CLE4001 #MLE4001	#CLE4002 #MLE4002	#CLE4003 #MLE4003	#CLE4004 #MLE4004
			
#CLE4005 #MLE4005	#CLE4006 #MLE4006	#CLE4007 #MLE4007	#CLE4008 #MLE4008
			

■ Function

- This part displays the value of a connected device as a free meter.
- The "range", "zone color/non-zone color", etc. can be changed with "Details edit" of free graphs.

■ Operation parameters



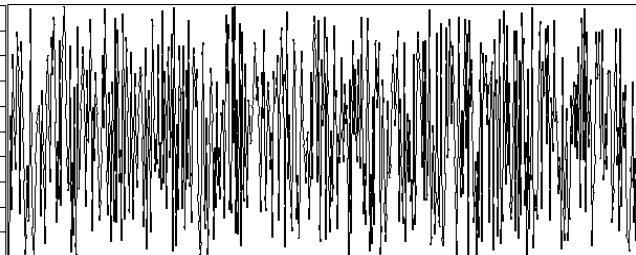
Operation Parameter	Initial Value	Description
[Free setup]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device for which a free meter is to be displayed.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="checkbox"/> [filter]		Specify this parameter to display a corrected value of the connected device.

■ Remark

- Do not specify any value other than "0: transparent" for "background color" of "Property of arrangement parts".

9. GRAPHS

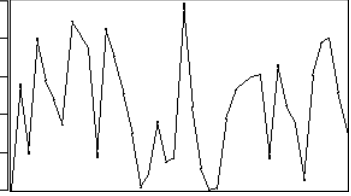

Graphs Trend graph	Trend graph	D: Refer to the table. S: Refer to the table.
#CLG1001 / #CLG1002 #MLG1001 / #MLG1002	#CLG1003 / #CLG1004 #MLG1003 / #MLG1004	
Trend graph	Bar trend graph	
D: About 150 bytes S: About 400 bytes	D: About 270 bytes S: About 470 bytes	
		
#CLG1005 / #CLG1006 #MLG1005 / #MLG1006		
Trend graph		
D: About 180 bytes S: About 2600 bytes		
		

■ Function

- This part reads the value of the connected device at each sampling time and displays the value as a trend graph.
- The range, color, etc. of this part can be changed with “Details edit” of the graph.

■ Operation parameters

[Common to trend graph and bar trend graph]

Operation Parameter	Initial Value	Description
[Break line/bar setup]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device whose value is to be displayed as a graph.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [sampling time]	2	Enter the sampling time value. Sampling is made at “set value” × 0.5ms”.
<input type="checkbox"/> [filter]		Specify this parameter to display a corrected value of the connected device.

[Trend graph]


Operation Parameter	Initial Value	Description
[Break line setup]		
<input type="radio"/> [flowing direction]	→	→: Data is right-shifted and the latest data is put on the left end. ←: Data is left-shifted and the latest data is put on the right end.
<input type="radio"/> [line piece]	1	Enter the number of lines to display.
<input type="radio"/> [line plot point]	50 or 600	Enter the number of plots to display at once.

[Bar trend graph]

Operation Parameter	Initial Value	Description
[Break line setup]		
<input type="radio"/> [number of bars]	40	Enter the number of bars to display at once.
<input type="radio"/> [bar width]	7	Enter the width of one bar.



Graphs Trend graph(data storing type)	Trend graph (data storing type)(1 line)	D: About 3300 bytes S: About 4800 bytes
--	--	--

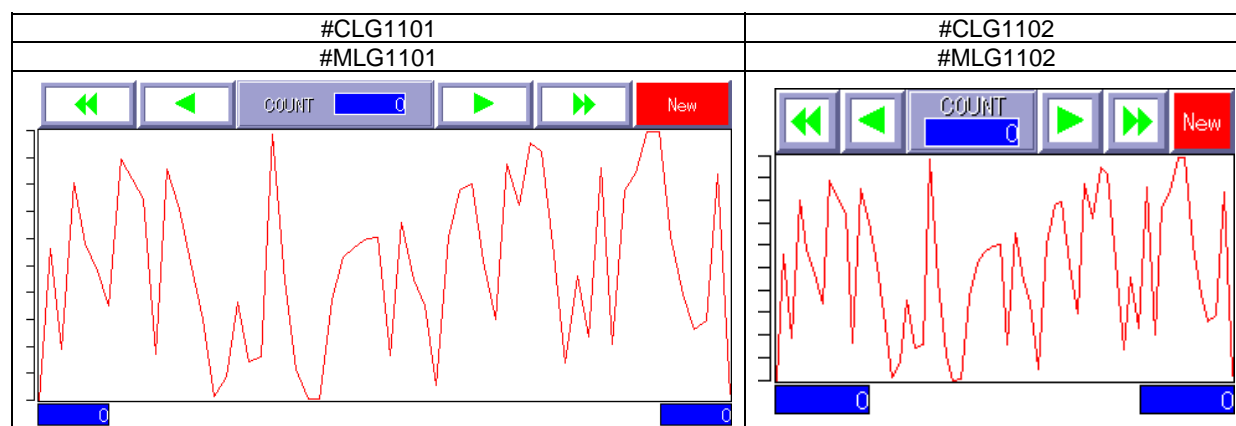

■ Function

- This part reads the value of the connected device at each sampling time and displays the value as a trend graph.
- Pressing the upper right switch of this part stops the display of the trend graph and displays the history data for “stored data items”. (Data sampling is kept as is during this stop time.)
- Pressing the upper right switch again restarts the display of the trend graph.
- Even when this part is displayed on a back screen, the latest history information is stored.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Break line setup]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device whose value is to be displayed as a graph.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [sampling time]	2	Enter the sampling time value. Sampling is made at “set value” × 0.5ms”.
<input type="radio"/> [flowing direction]	Fixed to “→”.	Data is right-shifted and the latest data is put on the left end.
<input type="checkbox"/> [filter]		Do not set this parameter.
<input type="radio"/> [line piece]	1	Fixed to “1”.
<input type="radio"/> [line plot point]	60	Enter the number of plots to display at once.


Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [number of data items]	300	Enter the number of data items for which trend information is to be stored.
<input type="radio"/> [upper limit value]	10000	Enter the value for initializing the counter (numeral display) to “0”.
<input type="radio"/> [number of plots]	60	Enter the same value as “number of plots” set for the “break line”.

■ Remark

- This part (break line) uses two controls; “trend display (LNE001) and “history display (LNE000).
To change the number of plots to be displayed on a break line, change the “line plot point” parameter, then specify the same value for the “line plot point for a break line” of “LNE000”.
- The operation parameters must be specified in the relationship of "upper limit counter value" ≤ "number of stored data items" ≤ "number of plots".



Graphs Trend graph(data storing type)	Trend graph (data storing type) (plural)	D: About 5100 bytes S: About 15000 bytes
--	---	---

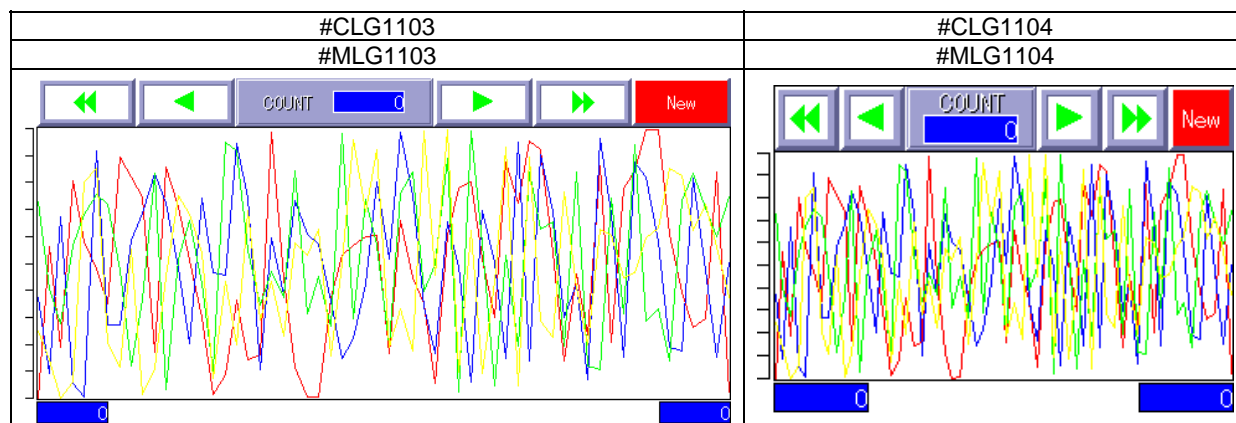

■ Function

- This part reads the value of a connected device at each sampling time and displays it on a trend graph.
- The upper right switch is pressed to stop the trend display and display the history data for "number of stored data items". (Data sampling is kept as is during this time.)
- Pressing the upper right switch again restarts the trend display.
- This part stores the latest history data even when arranged on the back screen.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Break line setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device for which a graph is to be displayed.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [sampling time]	2	Specify the sampling time. Sampling is performed at "specified value" × 0.5ms.
<input type="radio"/> [flowing direction]	Fixed to "→".	Data is shifted to the right and the latest data is displayed at the left end.
<input type="checkbox"/> [filter]		Do not specify this parameter.
<input type="radio"/> [line piece]	4	Specify the number of lines to display.
<input type="radio"/> [line plot point]	60	Specify the number of plots to display at once.




Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [number of data items]	300	Specify the number of data items to store as trend information.
<input type="radio"/> [number of lines]	4	Specify the name value as that of "number of lines" of the "break line".
<input type="radio"/> [upper limit]	10000	Specify the value at which the counter (numeral display) is cleared to "0".
<input type="radio"/> [number of plots]	60	Specify the same value as that of "number of plots" of the "break line".

■ Remark

- The trend graph of this part uses two controls of "trend display (LINE001)" and "history display (LINE000)".
To change "number of plots" for break line display and "number of lines", change "line plot point" and "number of lines" set for "operation parameters", then specify the updated values for "line plot point" and "line piece" of the "LINE000" break line with "EDIT CONTENTS" of the part.
- The operation parameters must be specified in the relationship of "upper limit counter value" \leq "number of stored data items" \leq "number of plots".



Graphs	Bar/line graph	D: Refer to the table.
Bar/line graph		S: Refer to the table.
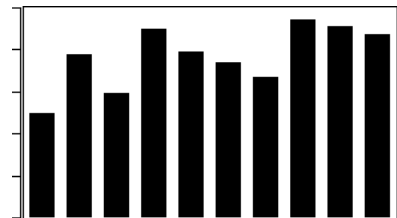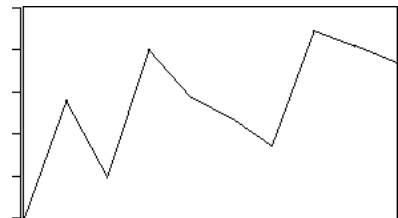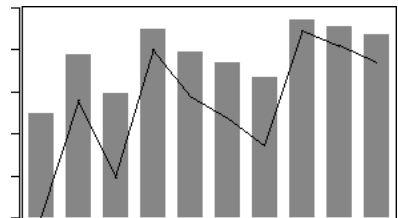
#CLG2001 / #CLG2002	#CLG2003 / #CLG2004	#CLG2005 / #CLG2006
#MLG2001 / #MLG2002	#MLG2003 / #MLG2004	#MLG2005 / #MLG2006
Bar graph	Line graph	Bar/line graph
D: About 350 bytes S: About 300 bytes	D: About 320 bytes S: About 260 bytes	D: About 620 bytes S: About 480 bytes
		

■ Function

- This part displays the value of the connected device (for the number of bars/lines × number of plots) as a bar/break line.
- For a “bar/break line” part, specify the same connected device for both the bar and the break line.
- The range, color, etc. of this part can be changed with “Details edit” of the graph.

■ Operation parameters

[Bar graph/bar & line graph]




Operation Parameter	Initial Value	Description
[Bar setup]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the first device whose value is to be displayed as a graph.
<input type="radio"/> [data type]	BIN	Specify the type of the connected device.
<input type="radio"/> [sampling time]	0	Fixed to “0”.
<input type="checkbox"/> [filter]		Specify this parameter to display a corrected value of the connected device.
<input type="radio"/> [number of bars]	10	Enter the number of bars to display at once. This value is assumed as the number of connected devices.
<input type="radio"/> [bar width]	19	Enter the width of one bar.

[Line graph/Bar & line graph]

Operation Parameter	Initial Value	Description
[Break line setup]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the first device whose value is to be displayed as a graph.
<input type="radio"/> [data type]	BIN	Specify the type of the connected devices.
<input type="radio"/> [sampling time]	0	Fixed to “0”.
<input type="radio"/> [flowing direction]	→	Invalid
<input type="checkbox"/> [filter]		Specify this parameter to display a corrected value of the connected device.
<input type="radio"/> [line piece]	1	Enter the number of lines to display.
<input type="radio"/> [line plot point]	10	Enter the number of plots to display at once. The value of “line piece” × “line plot point” is assumed as the number of connected devices.



Graphs Zone/circle graph	Belt/circle graph	D: Refer to the table. S: Refer to the table.
-----------------------------	--------------------------	--

#CLG3001	#CLG3002	#CLG3003
#MLG3001	#MLG3002	#MLG3003
Belt graph	Belt graph	Circle graph
D: About 150 bytes S: About 150 bytes	D: About 150 bytes S: About 150 bytes	D: About 160 bytes S: About 160 bytes
		

- **Function**
 - This part displays the values of the connected devices (for the number of zones) as a belt/circle.
 - The zone color, etc. of this part can be changed with “Details edit” of the graph.

■ **Operation parameters**

[Band]


Operation Parameter	Initial Value	Description
[Band setup]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number
<input checked="" type="radio"/> [device name]		Enter the name of the first device whose value is to be displayed as a graph.
<input type="radio"/> [data type]	BIN	Specify the type of the connected devices.
<input type="radio"/> [zones]	3	Enter the number of zones to be displayed on a graph. This value is assumed as the number of connected devices.

[Circle]

Operation Parameter	Initial Value	Description
[Circle setup]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number
<input checked="" type="radio"/> [device name]		Enter the name of the first device whose value is to be displayed as a graph.
<input type="radio"/> [data type]	BIN	Specify the type of the connected devices.
<input type="radio"/> [zones]	3	Enter the number of zones to be displayed on a graph. This value is assumed as the number of connected devices.



Graphs	Pareto chart	D: Refer to the table.
Pareto chart		S: Refer to the table.

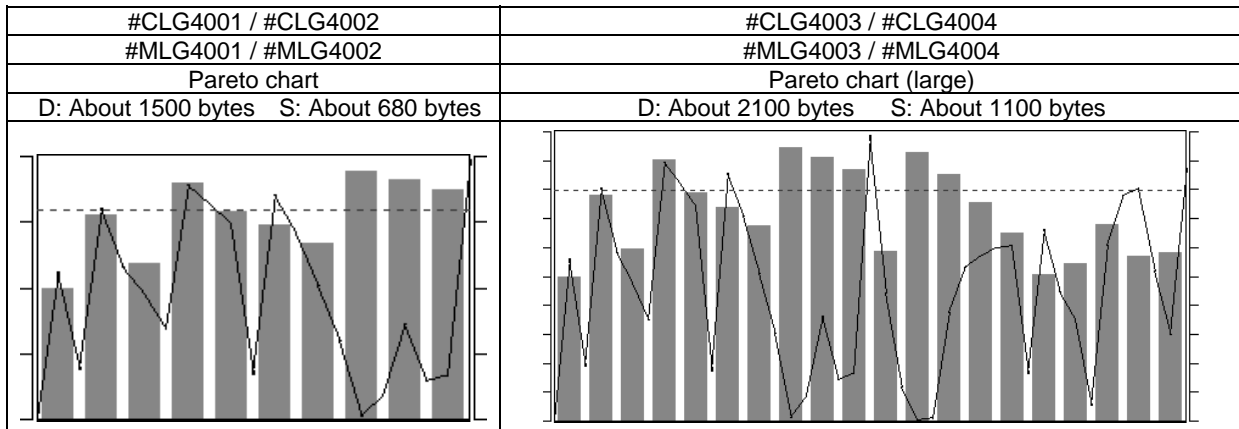

■ **Function**

- This part displays the values of the connected devices (for the number of bars) as a Pareto chart.
- A break line is displayed automatically according to the connected device value of the “bar”.
- The range, color, etc. of this part can be changed with “Details edit” of the bar.

■ **Operation parameters**

Operation Parameter	Initial Value	Description
[Bar setup]		
<input type="radio"/> [station No.]	01	Enter the name of the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the first device whose value is to be displayed as a graph.
<input type="radio"/> [data type]	BIN	Specify the type of the connected devices.
<input type="radio"/> [sampling time]	0	Fixed to “0”.
<input type="checkbox"/> [filter]		Specify this parameter to display a corrected value of the connected device.
<input type="radio"/> [number of bars]	10 or 20	Enter the number of bars to display at once. This value is assumed as the number of connected devices.
<input type="radio"/> [bar width]	19	Specify the width of one bar.

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [number of bars]	10 or 20	Enter the number of bars to display at once.
<input type="radio"/> [Pareto reference line (%)]	80	Specify the percentage to display the reference line.

■ **Remark**

- When a device whose value changes fast is connected, use a “bar/break line”.

10. CLOCKS AND CALENDARS



Clocks/calendars	Clock	D: About 160 bytes
Clock		S: About 140 bytes

#CAK1001	#CAK1002	#CAK1003	#CAK1004
#MAK1001	#MAK1002	#MAK1003	#MAK1004
16:23	16:23	16:23:47	16:23:47
#CAK1005	#CAK1101	#CAK1102	
#MAK1005	#MAK1101	#MAK1102	
16:23:47			

- Function
 - This part displays the time.
 - This part should preferably be arranged on a global screen. If this part is arranged by 16 or more on a local screen, it is regarded as an error.

Clocks/calendars	Calendar	D: About 500 bytes
Calendar		S: About 220 bytes

#CAK2001	#CAK2002	#CAK2003
#MAK2001	#MAK2002	#MAK2003
12/31/99	12/31/99	12/31/99
#CAK2004	#CAK2005	
#MAK2004	#MAK2005	
12/31/99 Sun	12/31/99 Sun	

- Function
 - This part displays date items (year, month, and day (the day of the week)).
 - A “calendar” part can correspond to years after 2000 and leap years. (The KDP5000 series is valid from “January 1, 1997 to December 31, 2096.”)
 - This part should preferably be arranged on a global screen. If this part is arranged by 16 or more on a local screen, it is regarded as an error.



Clocks/calendars	Clock/calendar setup	D: About 5300 bytes
Clock/calendar setup		S: About 1700 bytes

#CAK3001 #MAK3001	#CLK3002 #MLK3002
	(No texture is provided.)

■ Function

- This part displays date items and the time.

[#CAK3001/#MAK3001]

- Press the object item of the date. It can be set.

[Key operation]

[ENT]: Used to write the set “date” in the panel.

[ESC]: Used to stop setting. (When the part is a movable one, it is closed.)

[CLR]: Used to clear the currently set values.

[SKIP]: Used to move the cursor when the “date items” are to be set continuously.

[#CLK3002/#MLK3002]

- This part must be opened when arranged on a first screen.

■ Operation parameters

[#CAK3001/#MAK3001]

Operation Parameter	Initial Value	Description
[Template setup]		
△ [screen name having calendar]		Specify this parameter to notify the “calendar” part of the set “date items”.
△ [calendar part name]		


[#CLK3002/#MLK3002]

Operation Parameter	Initial Value	Description
[Template setup]		
○ [station No.]	01	Enter the PLC station number.
◎ [first device name]		Enter the name of the device which a date and time is to be read.
△ [screen name having calendar]		Specify this parameter to notify the “calendar” part of the set “date items”.
△ [calendar part name]		

11. ALARMS



Alarms	Error display (ERRPTS)	D: About 3100 bytes
Error display (ERRPTS)		S: About 590 bytes

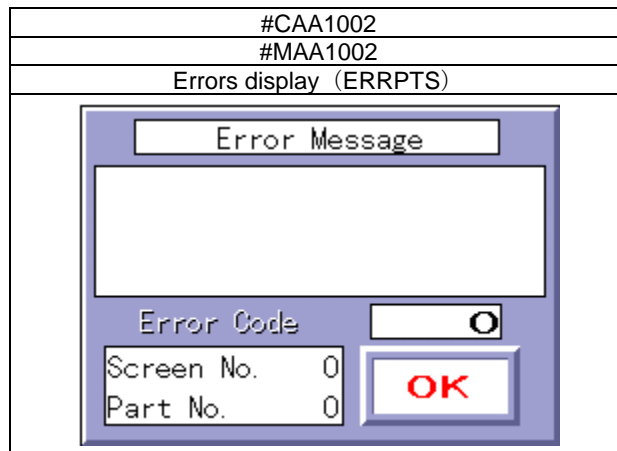

■ **Function**

- This part displays errors generated while the panel is operating.
- This part should be named as “ERRPTS” and closed when arranged on a global screen.
- This part is arranged as standard on a global screen created automatically.
- For error contents, refer to the “Troubleshooting and List of Error Codes”.

■ **Operation parameters**

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [clock error mask]	1	“0”: Detects errors. “1”: Not detect errors.
<input type="radio"/> [battery voltage drop error mask]	1	“0”: Detects errors. “1”: Not detect errors.
<input type="radio"/> [serial communication error mask]	0	“0”: Detects errors. “1”: Not detect errors.

■ **Remark**

- This part can also display errors that are usually displayed at the bottom of the panel screen when “Window Display” is specified for “Error Display Setup” on the system mode screen of the panel.



Alarms Warning display (bit devices)	List type warning display (bit devices)	D: About 4300 bytes S: About 2300 bytes
---	--	--

#CLA2000 / #CLA2001	#CLA2002 / #CLA2003																																																																																																																								
#MLA2000 / #MLA2001	#MLA2002 / #MLA2003																																																																																																																								
List type warning display	List type warning display (with CLOSE)																																																																																																																								
<div style="border: 1px solid black; padding: 5px;"> <p style="margin: 0;">WARNING COUNT <input type="checkbox"/> ▲ ▼</p> <table border="1" style="width: 100%; border-collapse: collapse; font-family: monospace;"> <tr><td>12</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>12</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>12</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>12</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>12</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>12</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>12</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>12</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>12</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>12</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>12</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>12</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> </table> </div>	12	12345678901	2345678901	2345678901	2345	12	12345678901	2345678901	2345678901	2345	12	12345678901	2345678901	2345678901	2345	12	12345678901	2345678901	2345678901	2345	12	12345678901	2345678901	2345678901	2345	12	12345678901	2345678901	2345678901	2345	12	12345678901	2345678901	2345678901	2345	12	12345678901	2345678901	2345678901	2345	12	12345678901	2345678901	2345678901	2345	12	12345678901	2345678901	2345678901	2345	12	12345678901	2345678901	2345678901	2345	12	12345678901	2345678901	2345678901	2345	<div style="border: 1px solid black; padding: 5px;"> <p style="margin: 0;"><input type="checkbox"/> CLOSE WARNING COUNT <input type="checkbox"/> ▲ ▼</p> <table border="1" style="width: 100%; border-collapse: collapse; font-family: monospace;"> <tr><td>99</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>99</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>99</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>99</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>99</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>99</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>99</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>99</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>99</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>99</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>99</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> <tr><td>99</td><td>12345678901</td><td>2345678901</td><td>2345678901</td><td>2345</td></tr> </table> </div>	99	12345678901	2345678901	2345678901	2345	99	12345678901	2345678901	2345678901	2345	99	12345678901	2345678901	2345678901	2345	99	12345678901	2345678901	2345678901	2345	99	12345678901	2345678901	2345678901	2345	99	12345678901	2345678901	2345678901	2345	99	12345678901	2345678901	2345678901	2345	99	12345678901	2345678901	2345678901	2345	99	12345678901	2345678901	2345678901	2345	99	12345678901	2345678901	2345678901	2345	99	12345678901	2345678901	2345678901	2345	99	12345678901	2345678901	2345678901	2345
12	12345678901	2345678901	2345678901	2345																																																																																																																					
12	12345678901	2345678901	2345678901	2345																																																																																																																					
12	12345678901	2345678901	2345678901	2345																																																																																																																					
12	12345678901	2345678901	2345678901	2345																																																																																																																					
12	12345678901	2345678901	2345678901	2345																																																																																																																					
12	12345678901	2345678901	2345678901	2345																																																																																																																					
12	12345678901	2345678901	2345678901	2345																																																																																																																					
12	12345678901	2345678901	2345678901	2345																																																																																																																					
12	12345678901	2345678901	2345678901	2345																																																																																																																					
12	12345678901	2345678901	2345678901	2345																																																																																																																					
12	12345678901	2345678901	2345678901	2345																																																																																																																					
12	12345678901	2345678901	2345678901	2345																																																																																																																					
99	12345678901	2345678901	2345678901	2345																																																																																																																					
99	12345678901	2345678901	2345678901	2345																																																																																																																					
99	12345678901	2345678901	2345678901	2345																																																																																																																					
99	12345678901	2345678901	2345678901	2345																																																																																																																					
99	12345678901	2345678901	2345678901	2345																																																																																																																					
99	12345678901	2345678901	2345678901	2345																																																																																																																					
99	12345678901	2345678901	2345678901	2345																																																																																																																					
99	12345678901	2345678901	2345678901	2345																																																																																																																					
99	12345678901	2345678901	2345678901	2345																																																																																																																					
99	12345678901	2345678901	2345678901	2345																																																																																																																					
99	12345678901	2345678901	2345678901	2345																																																																																																																					
99	12345678901	2345678901	2345678901	2345																																																																																																																					

■ **Function**

- This part displays a list of registered texts corresponding to the ON bits of the connected bit devices (total number of warning bits).
- This part must be closed when arranged on a global screen.
- This part is opened automatically when the connected bit devices (total number of warning bits) are turned on and closed automatically when all the connected bit devices are turned off. (For a part provided with a CLOSE switch, the CLOSE switch can be used to close the part.)
- Offset from “first bit device name” + “first registered text No.” is assumed as the numbers of the registered texts to display.

■ **Operation parameters**

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [first device name]		Enter the name of the first bit device for which a warning is to be displayed.
<input type="radio"/> [total number of warning bits]	50	Enter the total number of bit devices for which warnings are to be displayed.
<input type="radio"/> [first registered text No.]	1	Enter the number of the first registered text to be displayed as warning.

■ **Remark**

- Registered texts to display must be created and registered in advance.
- Specifying [total number of warning bits] too large degrades the performance of the panel itself.
To avoid this, use “list type warning display (word devices)”.
- When the “display control function” is valid and nothing is displayed on the panel screen, this part can display nothing even when it is opened. To avoid this, use a “back light control part” together with this part.

11. Alarms



Alarms Warning display (bit devices)	Warning scroll display (bit devices)	D: About 4100 bytes S: About 1600 bytes
---	---	--

#CLA2101	#CLA2102
#MLA2101	#MLA2102
Warning scroll display (40 characters)	Warning scroll display (80 characters)
1234567890123456789012345678901234567890	1234567890123456789012345678901234567890123456789012345678901234567890

■ Function

- This part displays a horizontal line of registered texts corresponding to the ON bits of the connected bit devices (total number of warning bits).
- This part must be closed when arranged on a global screen.
- This part is opened automatically when the connected bit devices (total number of warning bits) are turned on and closed automatically when all the connected bit devices are turned off.
- Offset from “first bit device name” + “first registered text No.” is assumed as the numbers of the registered texts to display.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [first device name]		Enter the name of the first bit device for which a warning is to be displayed.
<input type="radio"/> [total number of warning bits]	50	Enter the total number of bit devices for which warnings are to be displayed.
<input type="radio"/> [number of characters to display]	40 or 80	Enter the size of the character display in use.
<input type="radio"/> [scrolling speed]	3	Specify the scrolling speed. The larger the value is set, the slower the speed becomes.
<input type="radio"/> [number of characters to move]	2	Specify the number of characters to scroll at once.
<input type="radio"/> [display type (0/1)]	0	Specify a processing to be executed when a bit is reset before scrolling. “0”: Displays no message. “1”: Displays a message certainly.
<input type="radio"/> [first registered text No.]	1	Enter the number of the first registered text to be displayed as warning.

■ Remark

- The registered text to display must be created and registered in advance.
The registered text must be within one line (80 characters or less).
The registered text value must be greater than the value of “number of characters to move”.
- Specifying [total number of warning bits] too large degrades the performance of the panel itself.
To avoid this, use “warning scroll display (word devices)”.
- When the scrolling speed is increased, the operations of other parts may become slower.
To avoid this, make the “scrolling speed” lower and increase the value of “number of characters to move”.
- When the “display control function” is valid and nothing is displayed on the panel screen, this part can display nothing even when it is opened. To avoid this, use a “back light control part” together with this part.



Alarms Warning display (bit devices)	Warning history display (bit devices)	D: About 4800 bytes S: About 3000 bytes
---	--	--

#CLA2200 / #CLA2201
#MLA2200 / #MLA2201

■ Function

- This part displays a list of registered texts, dates, and detected/reset status corresponding to the ON/OFF bits of the connected bit devices (total number of warning bits).
- This part must be closed when arranged on a global screen.
- This part is opened automatically when the connected bit devices (total number of warning bits) are turned on/off and closed by the CLOSE switch.
- If any connected device is turned on/off while “History being updated now” is displayed for the “display guide”, the message is changed to “The history has been updated” without updating the display.
At this time, pressing “Display Guide” will display the warning history again.
- If “YES” is specified for “Auto Printing YES/NO”, data is printed out each time an alarm is detected/reset.
- Offset from “first bit device name” + “first registered text No.” is assumed as the numbers of the registered texts to display.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [first bit device name]		Enter the name of the first bit device for which a warning is to be displayed.
<input type="radio"/> [total number of warning bits]	50	Enter the total number of bit devices for which warnings are to be displayed.
<input type="radio"/> [number of records]	20	Specify the number of historic records to store.
<input type="radio"/> [first registered text No.]	1	Enter the number of the first registered text to be displayed as warning.
<input type="radio"/> [auto printing (1:YES/0:NO)]	0	Specify whether to print out warning each time it is detected/reset.

■ Remark

- Registered texts to display must be created and registered in advance.
- Connect a printer before printing out any warning.
- When the “display control function” is valid and nothing is displayed on the panel screen, this part can display nothing even when it is opened. To avoid this, use a “back light control part” together with this part.



Alarms Warning display (word devices)	List type warning display (word devices)	D: About 3700 bytes S: About 2100 bytes
--	---	--

#CLA3000 / #CLA3001 #MLA3000 / #MLA3001 List type warning display	#CLA3002 / #CLA3003 #MLA3002 / #MLA3003 List type warning display (with CLOSE)

■ Function

- This part displays a list of registered texts corresponding to the ON bits by regarding each of the connected word devices (total number of warning words) as a warning bit (total number of warning monitors).
- This part must be closed when arranged on a global screen.
- This part is opened automatically when the connected bit devices (total number of warning words) are turned on and closed automatically when all the connected bit devices are turned off. (For a part provided with a CLOSE switch, the CLOSE switch can be used to close the part.)
- Offset from “first word device name” + “first registered text No.” is assumed as the numbers of the registered texts to display. Word devices are counted as bit devices.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [first word device name]		Enter the name of the first word device for which a warning is to be displayed.
<input type="radio"/> [total number of warning words]	5	Enter the total number of word devices for which warnings are to be displayed.
<input type="radio"/> [total number of monitors]	80	Specify this value as “total number of warning words” × 16.
<input type="radio"/> [first registered text No.]	1	Enter the number of the first registered text to be displayed as warning.

■ Remark

- The registered text to display must be created and registered in advance.
- When the “display control function” is valid and nothing is displayed on the panel screen, this part can display nothing even when it is opened. To avoid this, use a “back light control part” together with this part.



Alarms Warning display (word devices)	Warning scroll display (word devices)	D: About 4500 bytes S: About 850 bytes
--	--	---

#CLA3101	#CLA3102
#MLA3101	#MLA3102
Warning scroll display (40 characters)	Warning scroll display (80 characters)
1234567890123456789012345678901234567890	1234567890123456789012345678901234567890123456789012345678901234567890

■ Function

- This part displays a horizontal line of registered texts corresponding to the ON bits by regarding each bit of the connected word devices (for the total number of warning words) as a warning bit (for the total number of warning monitors).
- This part must be closed when arranged on a global screen.
- This part is opened automatically when the connected word devices (for the total number of warning words) are turned on and closed automatically when all the connected word devices are turned off.
- Offset from “first word device name” + “first registered text No.” is assumed as the numbers of the registered texts to display. Word devices are counted as bit devices.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [first device name]		Enter the name of the first word device for which a warning is to be displayed.
<input type="radio"/> [total number of warning words]	5	Enter the total number of word devices for which warnings are to be displayed.
<input type="checkbox"/> [number of characters to display]	40 or 80	Enter the size of the character display in use.
<input type="radio"/> [scrolling speed]	3	Specify the scrolling speed. The larger the value is set, the slower the speed becomes.
<input type="radio"/> [number of characters to move]	2	Specify the number of characters to scroll at once.
<input type="radio"/> [display type (0/1)]	0	Specify a processing to be executed when a bit is reset before scrolling. “0”: Displays no message. “1”: Displays a message certainly.
<input type="radio"/> [first registered text No.]	1	Enter the number of the first registered text to be displayed as warning.
<input type="radio"/> [total number of warning monitors]	80	Specify this value as “total number of warning words” × 16.

■ Remark

- The registered text to display must be created and registered in advance. The registered text must be within one line (80 characters or less). The registered text value must be greater than the value of “number of characters to move”.
- When the scrolling speed is increased, the operations of other parts may become slower. To avoid this, make the “scrolling speed” lower and increase the value of “number of characters to move”.
- When the “display control function” is valid and nothing is displayed on the panel screen, this part can display nothing even when it is opened. To avoid this, use a “back light control part” together with this part.

12. TEXTURE DISPLAYS



Texture displays	Registered texture display	D: About 100 bytes S: About 120 bytes
------------------	-----------------------------------	--

#CLF1001
#MLF1001
(No texture is provided.)

■ Function

- This part displays registered texture according to the value of the connected device.
- The value of “Connected device value” + “Head No. of texture.” is assumed as the number of the registered texture to display.
- This part setup differs between word device and bit device.

[For a word connected device]

- This part displays the registered texture of the number corresponding to the value of the connected device.

[For a bit connected device]

- This part displays the registered texture of the number corresponding to the position from the first turned-ON device of the “continuous device” started at the first connected device.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Character display setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device that specifies the registered texture number.
<input type="radio"/> [continuous device]	1	Word device: Enter “1”. Bit device: Enter the number of bit devices to use.
<input type="radio"/> [data type]	BIN	Specify the type of the connected devices.
<input type="radio"/> [head No. of texture.]	1	Enter the number of the first registered texture to display.


■ Remark

- The texture to display must be created and registered in advance.

13. SPECIAL PARTS



Special parts	Screen print	D: Refer to the table.
Screen print		S: Refer to the table.

#CAZ1001	#CLZ1001
#MAZ1001	#MLZ1001
Screen print switch	Screen print control
D: About 310 bytes S: About 140 bytes	D: About 190 bytes S: About 80 bytes
	(No texture is used.)

■ Function

[Screen print switch]

- This switch hard-copies screen data.

[Screen print control]

- This part hard-copies screen data when the connected device value is 1.

■ Operation parameters

[Screen print switch]

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [color No.] (color parts only)	8	Specify a color to become black with a pallet number when using a monochrome printer. This parameter is invalid when in color printing.

[Screen print control]

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [connected device name]		Enter the name of the device for which screen data is to be printed out.
<input type="radio"/> [color No.] (color parts only)	8	Specify a color to become black with a pallet number when using a monochrome printer. This parameter is invalid when in color printing.


■ Remark

- Connect a printer before printing out screen data.

13. Special Parts



Special parts	Parts control	D: Refer to the table.
Parts control		S: Refer to the table.

#CAZ2001	#CLZ2001
#MAZ2001	#MLZ2001
Parts control switch (OPEN/CLOSE)	Parts control (OPEN/CLOSE)
D: About 320 bytes S: About 140 bytes	D: About 240 bytes S: About 80 bytes
	(No texture is used.)

■ Function

[Parts control switch (OPEN/CLOSE)]

- This switch is turned on to open the object part and turned off to close the part.

[Parts control (OPEN/CLOSE)]

- This switch opens the object part when the value of the connected device is 1 and closes the part when it is 0.

■ Operation parameters

[Parts control switch (OPEN/CLOSE)]

Operation Parameter	Initial Value	Description
[Template setup]		
△ [screen name having object part]		Enter the name of the global screen when the object part exists on the screen. Enter nothing if the object part exists on the self-screen.
⊙ [object part name]		Enter the name of the object part to open/close.
△ [self-screen: 1/global screen: none]	1	Enter "1" when the object part exists on the self-screen. Enter nothing if the object part exists on a global screen.


[Parts control (OPEN/CLOSE)]

Operation Parameter	Initial Value	Description
[Template setup]		
○ [station No.]	01	Enter the PLC station number.
⊙ [connected device name]		Enter the name of the device that controls parts.
△ [screen name having object part]		Enter the name of the global screen when the object part exists on the screen. Enter nothing if the object part exists on the self-screen.
⊙ [object part name]		Enter the name of the object part to open/close.
△ [self-screen: 1/global screen: none]	1	Enter "1" when the object part exists on the self-screen. Enter nothing if the object part exists on a global screen.

■ Remark

- Specify "enable movement" for the object part. Otherwise, the part cannot be closed.

Special parts Brightness adjustment	Brightness adjustment	D: About 1600 bytes S: About 1100 bytes
--	------------------------------	--

#CAZ3001
#MAZ3001


- Function
 - This part adjusts the brightness of the panel screen in 8 steps.
- Remark
 - This part is the same as that arranged on the “system mode screen” of the panel.



Special parts Back-light control	Back-light control	D: Refer to the table. S: Refer to the table.
-------------------------------------	---------------------------	--

#CLZ4001	#CLZ4002
#MLZ4001	#MLZ4002
Back-light control	Back-light continuous ON
D: About 230 bytes S: About 80 bytes	D: About 260 bytes S: About 90 bytes
(No texture is used.)	(No texture is provided.)

■ **Function**

[Back-light control]

- This part turns off the back-light of the panel screen when the value of the connected device is 1 and turns it on when the value is 0.
- This part must be closed when arranged on a global screen.

[Back-light continuous ON]

- This part resets the panel display control time temporarily to keep the back-light on when the value of the connected device is 1.



When the value is 0, this part restores the initial panel display control time.

- This part is valid only when the panel display control time is set.
- This part must be closed when arranged on a global screen.

■ **Operation parameters**

Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [connected device name]		Enter the name of the device that controls the back-light of the panel screen.

Special parts	Interlock control	D: Refer to the table.
Interlock control		S: Refer to the table.

#CAZ5001	#CAZ5002
#MAZ5001	#MAZ5002
Interlock control (2-point push)	Interlock control (reset time setting)
D: About 500 bytes S: About 230 bytes	D: About 480 bytes S: About 170 bytes
	

■ **Function**

- This part interlocks the screen not to go to the “system mode screen” when both “lower right” and “upper left of the panel screen are pressed concurrently.
- Arrangement of this part enables the screen to be interlocked just after the panel is started.
[Interlock control (2-point push)]
- This part resets an interlock when the right switch is pressed while the left switch is held down. (If the right switch is pressed while the left switch is held down, only the right switch makes a click sound.)
[Interlock control (reset time setting)]
- Pressing a switch in this part resets the interlock for a “wait time (sec)”. In the “wait time (sec), the screen is interlocked again.

■ **Operation parameters**

[Interlock control (reset time setting)]


Operation Parameter	Initial Value	Description
[Template setup]		
<input type="radio"/> [wait time (sec)]	3	Specify the reset time to be kept until it is set.

■ **Remark**

- Be careful not to forget the place where the “interlock control” part is arranged. Otherwise, you will never return to the “system mode” screen.



Special parts Heat regulator	Heat regulator	D: About 2500 bytes S: About 430 bytes
---------------------------------	-----------------------	---

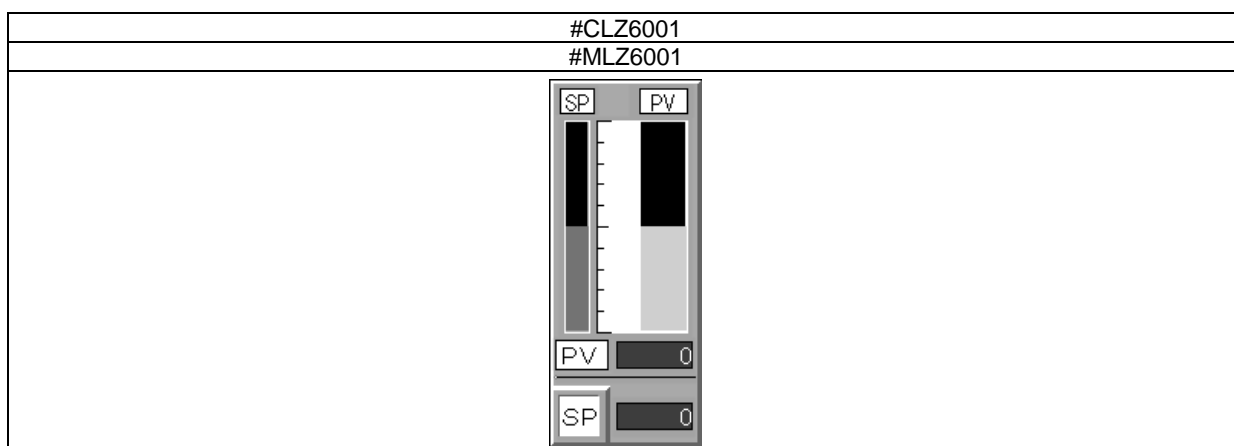

- **Function**
 - This part sets up and displays a heat regulator.
 - This part is combined with a “ten-key pad (for input numeral display)” for use.
 - The “SP” numeral input function of this part is the same as that of the “input numeral display (word)” parts.
For the operation parameters, refer to those of “input numeral display (word)” parts.
 - Specify the same connected device in PV and SP.

■ **Operation parameters**
[Number indicator: NUM_PV]

Operation Parameter	Initial Value	Description
[Number indicator setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device whose value is to be displayed as a numeral (PV).
<input type="radio"/> [device type]	Word	Enter the number of words to display
<input type="radio"/> [endian]	little	Valid when double words are specified. From bottom to top: The lower word comes first. From top to bottom: The upper word comes first.
<input type="radio"/> [data type]	sign BIN	Specify the type of connected device.
<input type="checkbox"/> [filter]		Specify this parameter to display a corrected value of the connected device.
<input type="radio"/> [color]	1 or 11	Specify the color of the number.

[Bar : BAR_PV/BAR_SP]

Operation Parameter	Initial Value	Description
[Bar setup]		
<input type="radio"/> [station No.]	01	Enter the PLC station number.
<input checked="" type="radio"/> [device name]		Enter the name of the device whose value is to be displayed as (PV/SP).
<input type="radio"/> [data type]	BIN	Specify the type of connected device.
<input type="radio"/> [sampling time]	0	Fixed to “0”.
<input type="checkbox"/> [filter]		Specify this parameter to display a corrected value of the connected device.
<input type="radio"/> [number of bars]	1	Fixed to “1”.
<input type="radio"/> [bar width]	30 or 15	Specify the number of dots as the width of the bar.

[Template]: Refer to the “input numeral display (word)” parts.

Special parts	Non-protocol communication	D: Refer to the table.
Non-protocol communication		S: Refer to the table.

#CGZ7001	#CGZ7002				
#MGZ7001	#MGZ7002				
Non-protocol communication	Non-protocol communication (DEBUG)				
D: About 900 bytes S: About 380 bytes	D: About 1100 bytes S: About 520 bytes				
(No texture is used.)	<table border="1" style="margin: auto;"> <tr> <td style="padding: 5px;">SEND</td> <td style="width: 100px; height: 20px;"></td> </tr> <tr> <td style="padding: 5px;">RECEIVE</td> <td style="width: 100px; height: 20px;"></td> </tr> </table>	SEND		RECEIVE	
SEND					
RECEIVE					

■ **Function**

- The K-Basic, which is the basic part of non-protocol communications, is described in this part (sample program). Create non-protocol communication programs with reference to this part program.
- This sample program uses the “text mode” of non-protocol communications to set “&h0D” as a terminator code.
- Each “DEBUG” part displays send/receive data as characters.
- This sample program does not execute the “CLOSESIO” command. To change any screen, add the “CLOSESIO” command.

[Sample program protocol]

- This protocol is also used for the “C series” of “OMRON”.

[Transmission format]

@	00 <small>(serial No.)</small>	RD <small>(header code)</small>	???? <small>(CH No.)</small>	0001 <small>(read CH count)</small>	FCS <small>(checksum)</small>	* ↓ <small>(terminator)</small>
---	-----------------------------------	------------------------------------	---------------------------------	--	----------------------------------	------------------------------------

[Receive format]

@	00 <small>(serial No.)</small>	RD <small>(header code)</small>	00 <small>(end No.)</small>	???? <small>(read data)</small>	FCS <small>(checksum)</small>	* ↓ <small>(terminator)</small>
---	-----------------------------------	------------------------------------	--------------------------------	------------------------------------	----------------------------------	------------------------------------

■ **Operation parameters**

Operation Parameter	Initial Value	Description
[Template setup]		
○ [port No.]	1	Specify the port number of the panel used for non-protocol communications. “1”: RS-232C CH1 “2”: RS-232C CH2 “3”: RS-485 (CH3)
○ [sampling time]	5	Specify the data transmission interval when the panel becomes a master station. Data is transmitted at intervals of “set value × 100 ms”.

■ **Remark**

- Specify the communication type to “not used” for the non-protocol communication port and make the communication items including the communication rate match with those of the connected devices.
- Setting the “sampling time” faster will cause the operations of other parts to be slowed down.
- When using the RS-485 port as a half-duplex port, transmitted data is returned as receive data. Take this into consideration when creating non-protocol communication programs.

14. HOST COMMAND COMMUNICATION PARTS



Host command communication parts Numeral display (host command)	Numeral display (host commands)	D: About 280 bytes S: About 130 bytes
--	--	--

#CHN1001 #MHN1001	#CHN1002 #MHN1002	#CHN1003 #MHN1003	#CHN1004 #MHN1004	#CHN1005 #MHN1005
123456	123456	123456	123456	123456
#CHN1006 #MHN1006	#CHN1007 #MHN1007	#CHN1008 #MHN1008	#CHN1009 #MHN1009	#CHN1010 #MHN1010
123456	123456	123456	123456	123456
#CHN1011 #MHN1011	#CHN1012 #MHN1012	#CHN1013 #MHN1013	#CHN1014 #MHN1014	#CHN1015 #MHN1015
12345678	12345678	12345678	12345678	12345678
#CHN1016 #MHN1016	#CHN1017 #MHN1017	#CHN1018 #MHN1018		
12345678	12345678	12345678		

■ Function

- This part is used for host command communications.
- This part displays numerals sent through host command communications.



Host command communication parts Character display (host commands)	Character display (host commands)	D: About 280 bytes S: About 130 bytes
---	--	--

#CHM1001 #MHM1001	#CHM1002 #MHM1002	#CHM1003 #MHM1003
ABCDEFGHI J	ABCDEFGHI J	ABCDEFGHI J
#CHM1004 #MHM1004	#CHM1005 #MHM1005	#CHM1006 #MHM1006
ABCDEFGHI J	ABCDEFGHI J	ABCDEFGHI J
#CHM1007 #MHM1007	#CHM1008 #MHM1008	#CHM1009 #MHM1009
ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST
#CHM1010 #MHM1010	#CHM1011 #MHM1011	#CHM1012 #MHM1012
ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST	ABCDEFGHI JKLMNOPQRST

■ **Function**

- This part is used for host command communications.
- This part displays texts sent through host command communications.



Host command communication parts Lamp (host commands) LED	LED (host commands)	D: About 290 bytes S: About 110 bytes
---	--------------------------------	--

#CHL1001	#CHL1002	#CHL1003	#CHL1004	#CHL1005	#CHL1006	#CHL1007	#CHL1008
#MHL1001			#MHL1004			#MHL1007	
#CHL1009	#CHL1010	#CHL1011	#CHL1012	#CHL1013	#CHL1014	#CHL1015	#CHL1016
	#MHL1010			#MHL1013			#MHL1016
#CHL1017	#CHL1018	#CHL1019	#CHL1020	#CHL1021	#CHL1022	#CHL1023	#CHL1024
			#MHL1020			#MHL1023	
#CHL1025	#CHL1026	#CHL1027	#CHL1028	#CHL1029	#CHL1030	#CHL1031	#CHL1032
	#MHL1026			#MHL1029			#MHL1032
#CHL1033	#CHL1034	#CHL1035	#CHL1036	#CHL1037			
		#MHL1035					

■ Function

- This part is used for host command communications.
- This part (lamp) comes on when the value sent through host command communications is 1 and goes off when the value is 0.

14. Host Command Communication Parts



Host command communication parts Lamp (host commands) Mark lamp	Mark lamp (host commands)	D: About 290 bytes S: About 110 bytes
---	--------------------------------------	--

#CHL2001	#CHL2002	#CHL2003	#CHL2004	#CHL2005	#CHL2006	#CHL2007	#CHL2008
#MHL2001	#MHL2002	#MHL2003	#MHL2004	#MHL2005	#MHL2006	#MHL2007	#MHL2008
#CHL2009	#CHL2010	#CHL2011	#CHL2012	#CHL2013	#CHL2014	#CHL2015	#CHL2016
#MHL2009	#MHL2010	#MHL2011	#MHL2012	#MHL2013	#MHL2014	#MHL2015	#MHL2016
#CHL2017	#CHL2018	#CHL2019	#CHL2020	#CHL2021	#CHL2022	#CHL2023	#CHL2024
#MHL2017	#MHL2018	#MHL2019	#MHL2020	#MHL2021	#MHL2022	#MHL2023	#MHL2024
#CHL2025	#CHL2026	#CHL2027	#CHL2028	#CHL2029	#CHL2030	#CHL2031	#CHL2032
#MHL2025	#MHL2026	#MHL2027	#MHL2028	#MHL2029	#MHL2030	#MHL2031	#MHL2032

Host command communication parts Lamp (host commands) Name plate lamp	Name plate lamp (host commands)	D: About 310 bytes S: About 110 bytes
---	--	--

#CLL3001	#CLL3002	#CLL3003	#CLL3004	#CLL3005	#CLL3006	#CLL3007	#CLL3008
#MLL3001	#MLL3002	#MLL3003	#MLL3004	#MLL3005	#MLL3006	#MLL3007	#MLL3008
#CLL3009	#CLL3010	#CLL3011	#CLL3012	#CLL3013	#CLL3014	#CLL3015	#CLL3016
#MLL3009	#MLL3010	#MLL3011	#MLL3012	#MLL3013	#MLL3014	#MLL3015	#MLL3016

■ Function

- This part is used for host command communications.
- This part (lamp) comes on when the value sent through host command communications is 1 and goes off when the value is 0.



Host command communication parts Switch (host commands) Mark switch	Mark switch (host commands)	D: About 340 bytes S: About 150 bytes
---	--	--

#CHS1001	#CHS1002	#CHS1003	#CHS1004	#CHS1005	#CHS1006	#CHS1007	#CHS1008
#MHS1001		#MHS1003	#MHS1004	#MHS1005	#MHS1006	#MHS1007	#MHS1008
#CHS1009	#CHS1010	#CHS1011	#CHS1012	#CHS1013	#CHS1014	#CHS1015	#CHS1016
#MHS1009	#MHS1010	#MHS1011	#MHS1012	#MHS1013	#MHS1014	#MHS1015	#MHS1016
#CHS1017	#CHS1018	#CHS1019	#CHS1020				
#MHS1017	#MHS1018	#MHS1019	#MHS1020				

Host command communication parts Switch (host commands) Name plate switch	Name plate switch (host commands)	D: About 350 bytes S: About 150 bytes
---	--	--

#CHS2001	#CHS2002	#CHS2003	#CHS2004	#CHS2005	#CHS2006	#CHS2007	#CHS2008
#MHS2001	#MHS2002	#MHS2003	#MHS2004	#MHS2005	#MHS2006	#MHS2007	#MHS2008
#CHS2009	#CHS2010	#CHS2011	#CHS2012				
#MHS2009	#MHS2010	#MHS2011	#MHS2012				

- Function
 - This part is used for host command communications.
 - This part transmits its ON/OFF status to the host.

■ Operation parameters

Operation Parameter	Initial Value	Description
[Template setup]		
○ [transmit text]	""	Enter the text to be sent to the host together with the ON/OFF status. Enter the text in "". When sending no text, delete the "" portion.

ISO7000 0001 - 0100	ISO_0001 - ISO_0100
------------------------	----------------------------

0001	0002	0003	0004	0005	0006	0007	0008	0009	0010
0011	0012	0013	0014	0015	0016	0017	0018	0019	0020
0021	0022	0023	0024	0025	0026	0027	0028	0029	0030
0031	0032	0033	0034	0035	0036	0037	0038	0039	0040
0041	0042	0043	0044	0045	0046	0047	0048	0049	0050
0051	0052	0053	0054	0055	0056	0057	0058	0059	0060
0061	0062	0063	0064	0065	0066	0067	0068	0069	0070
0071	0072	0073	0074	0075	0076	0077	0078	0079	0080
0081	0082	0083	0084	0085	0086	0087	0088	0089	0090
0091	0092	0093	0094	0095	0096	0097	0098	0099	0100

ISO7000
0101 - 0200

ISO_0101 - ISO_0200

0101	0102	0103	0104	0105	0106	0107	0108	0109	0110
0111	0112	0113	0114	0115	0116	0117	0118	0119	0120
0121	0122	0123	0124	0125	0126	0127	0128	0129	0130
0131	0132	0133	0134	0135	0136	0137	0138	0139	0140
0141	0142	0143	0144	0145	0146	0147	0148	0149	0150
0151	0152	0153	0154	0155	0156	0157	0158	0159	0160
0161	0162	0163	0164	0165	0166	0167	0168	0169	0170
0171	0172	0173	0174	0175	0176	0177	0178	0179	0180
0181	0182	0183	0184	0185	0186	0187	0188	0189	0190
0191	0192	0193	0194	0195	0196	0197	0198	0199	0200

ISO7000 0201 - 0300		ISO_0201 - ISO_0300							
0201	0202	0203	0204	0205	0206	0207	0208	0209	0210
0211	0212	0213	0214	0215	0216	0217	0218	0219	0220
0221	0222	0223	0224	0225	0226	0227	0228	0229	0230
0231	0232	0233	0234	0235	0236	0237	0238	0239	0240
0241	0242	0243	0244	0245	0246	0247	0248	0249	0250
0251	0252	0253	0254	0255	0256	0257	0258	0259	0260
0261	0262	0263	0264	0265	0266	0267	0268	0269	0270
0271	0272	0273	0274	0275	0276	0277	0278	0279	0280
0281	0282	0283	0284	0285	0286	0287	0288	0289	0290
0291	0292	0293	0294	0295	0296	0297	0298	0299	0300

ISO7000 0301 - 0400		ISO_0301 - ISO_0400							
0301	0302	0303	0304	0305	0306	0307	0308	0309	0310
0311	0312	0313	0314	0315	0316	0317	0318	0319	0320
0321	0322	0323	0324	0325	0326	0327	0328	0329	0330
0331	0332	0333	0334	0335	0336	0337	0338	0339	0340
0341	0342	0343	0344	0345	0346	0347	0348	0349	0350
0351	0352	0353	0354	0355	0356	0357	0358	0359	0360
0361	0362	0363	0364	0365	0366	0367	0368	0369	0370
0371	0372	0373	0374	0375	0376	0377	0378	0379	0380
0381	0382	0383	0384	0385	0386	0387	0388	0389	0390
0391	0392	0393	0394	0395	0396	0397	0398	0399	0400

ISO7000
0401 - 0500

ISO_0401 - ISO_0500

0401	0402	0403	0404	0405	0406	0407	0408	0409	0410
0411	0412	0413	0414	0415	0416	0417	0418	0419	0420
0421	0422	0423	0424	0425	0426	0427	0428	0429	0430
0431	0432	0433	0434	0435	0436	0437	0438	0439	0440
0441	0442	0443	0444	0445	0446	0447	0448	0449	0450
0451	0452	0453	0454	0455	0456	0457	0458	0459	0460
0461	0462	0463	0464	0465	0466	0467	0468	0469	0470
0471	0472	0473	0474	0475	0476	0477	0478	0479	0480
0481	0482	0483	0484	0485	0486	0487	0488	0489	0490
0491	0492	0493	0494	0495	0496	0497	0498	0499	0500

ISO7000
0501 - 0600

ISO_0501 - ISO_0600

0501	0502	0503	0504	0505	0506	0507	0508	0509	0510
0511	0512	0513	0514	0515	0516	0517	0518	0519	0520
0521	0522	0523	0524	0525	0526	0527	0528	0529	0530
0531	0532	0533	0534	0535	0536	0537	0538	0539	0540
0541	0542	0543	0544	0545	0546	0547	0548	0549	0550
0551	0552	0553	0554	0555	0556	0557	0558	0559	0560
0561	0562	0563	0564	0565	0566	0567	0568	0569	0570
0571	0572	0573	0574	0575	0576	0577	0578	0579	0580
0581	0582	0583	0584	0585	0586	0587	0588	0589	0590
0591	0592	0593	0594	0595	0596	0597	0598	0599	0600

ISO7000
0601 - 0700

ISO_0601 - ISO_0700

0601	0602	0603	0604	0605	0606	0607	0608	0609	0610
0611	0612	0613	0614	0615	0616	0617	0618	0619	0620
0621	0622	0623	0624	0625	0626	0627	0628	0629	0630
0631	0632	0633	0634	0635	0636	0637	0638	0639	0640
0641	0642	0643	0644	0645	0646	0647	0648	0649	0650
0651	0652	0653	0654	0655	0656	0657	0658	0659	0660
0661	0662	0663	0664	0665	0666	0667	0668	0669	0670
0671	0672	0673	0674	0675	0676	0677	0678	0679	0680
0681	0682	0683	0684	0685	0686	0687	0688	0689	0690
0691	0692	0693	0694	0695	0696	0697	0698	0699	0700

ISO7000 0701 - 0800	ISO_0701 - ISO_0800
------------------------	----------------------------

0701	0702	0703	0704	0705	0706	0707	0708	0709	0710
0711	0712	0713	0714	0715	0716	0717	0718	0719	0720
0721	0722	0723	0724	0725	0726	0727	0728	0729	0730
0731	0732	0733	0734	0735	0736	0737	0738	0739	0740
0741	0742	0743	0744	0745	0746	0747	0748	0749	0750
0751	0752	0753	0754	0755	0756	0757	0758	0759	0760
0761	0762	0763	0764	0765	0766	0767	0768	0769	0770
0771	0772	0773	0774	0775	0776	0777	0778	0779	0780
0781	0782	0783	0784	0785	0786	0787	0788	0789	0790
0791	0792	0793	0794	0795	0796	0797	0798	0799	0800

ISO7000 0801 - 0900	ISO_0801 - ISO_0900
------------------------	----------------------------

0801	0802	0803	0804	0805	0806	0807	0808	0809	0810
0811	0812	0813	0814	0815	0816	0817	0818	0819	0820
0821	0822	0823	0824	0825	0826	0827	0828	0829	0830
0831	0832	0833	0834	0835	0836	0837	0838	0839	0840
0841	0842	0843	0844	0845	0846	0847	0848	0849	0850
0851	0852	0853	0854	0855	0856	0857	0858	0859	0860
0861	0862	0863	0864	0865	0866	0867	0868	0869	0870
0871	0872	0873	0874	0875	0876	0877	0878	0879	0880
0881	0882	0883	0884	0885	0886	0887	0888	0889	0890
0891	0892	0893	0894	0895	0896	0897	0898	0899	0900





























ISO7000 0901 - 1000	ISO_0901 - ISO_1000
------------------------	----------------------------

0901	0902	0903	0904	0905	0906	0907	0908	0909	0910
0911	0912	0913	0914	0915	0916	0917	0918	0919	0920
0921	0922	0923	0924	0925	0926	0927	0928	0929	0930
0931	0932	0933	0934	0935	0936	0937	0938	0939	0940
0941	0942	0943	0944	0945	0946	0947	0948	0949	0950
0951	0952	0953	0954	0955	0956	0957	0958	0959	0960
0961	0962	0963	0964	0965	0966	0967	0968	0969	0970
0971	0972	0973	0974	0975	0976	0977	0978	0979	0980
0981	0982	0983	0984	0985	0986	0987	0988	0989	0990
0991	0992	0993	0994	0995	0996	0997	0998	0999	1000

ISO7000 1001 - 1100	ISO_1001 - ISO_1100
------------------------	----------------------------

1001	1002	1003	1004	1005	1006	1007	1008	1009	1010
1011	1012	1013	1014	1015	1016	1017	1018	1019	1020
1021	1022	1023	1024	1025	1026	1027	1028	1029	1030
1031	1032	1033	1034	1035	1036	1037	1038	1039	1040
1041	1042	1043	1044	1045	1046	1047	1048	1049	1050
1051	1052	1053	1054	1055	1056	1057	1058	1059	1060
1061	1062	1063	1064	1065	1066	1067	1068	1069	1070
1071	1072	1073	1074	1075	1076	1077	1078	1079	1080
1081	1082	1083	1084	1085	1086	1087	1088	1089	1090
1091	1092	1093	1094	1095	1096	1097	1098	1099	1100

ISO7000 1101 - 1140	ISO_1101 - ISO_1140
------------------------	----------------------------

1101	1102	1103	1104	1105	1106	1107	1108	1109	1110
									
1111	1112	1113	1114	1115	1116	1117	1118	1119	1120
									
1121	1122	1123	1124	1125	1126	1127	1128	1129	1130
									
1131	1132	1133	1134	1135	1136	1137	1138	1139	1140
